

(1) DOOR

(A) WINDOW → WALL TYPE

=== EXG. WALL TO REMAIN = = EXG. WALL TO BE REMOVED

MEW WALL

ABBREVIATIONS

A.C.T.	ACOUSTICAL CEILING TILE	JAN.	JANITOR	
A.B.	ANCHOR BOLT	JT.	JOINT	
A.F.F	ABOVE FINISH FLOOR	LAM	LAMINATE	
ALT ALU	ALTERNATE ALUMINUM	LAV	LAVATORY	
ASPH	ASPHALT	L.P.	LOW POINT	
BD	BOARD	MAX	MAXIMUM	
BLDG	BUILDING	MECH	M	
BLKG	BLOCKING			
BM	BEAM	MIN.	MINIMUM	
ВОТ	ВОТТОМ	MISC	MISCELLANIOUS	
BS	BOTH SIDES	M.O.	MASONRY OPENING	
CLG	cEILING	Wi.O.	WAGGINT OF ENING	
CLR	CLEAR	MTD.	MOUNTED	
CMU	CONCRETE MASONRY UNIT	MTL	METAL	
COL	COLUMN	N.I.C.	NOT IN CONTRACT	
CONC.	CONCRETE			
CONT.	CONTINUOUS	NO.	NUMBER	
CONTR.	CONTRACTOR	N.T.S.	NOT TO SCALE	
C.J.	CONTROL JOINT	O.C.	ON CENTER	
C.T.	CERAMIC TILE	O.D.	OUTSIDE DIAMETER	
CTR	CENTER			
DBL	DOUBLE	O.H.	OVERHEAD	
DIA	DOWN	OPNG	OPENING	
DN.	DOWN	P.B.C. PLUMBING CONTRACTOR		
DR DS	DOWNSPOUT			
DET	DETAIL	PL PLATE		
DTL	DETAIL	PLAS LAM	PLASTIC LAMINATE	
DWG	DRAWING	PLWD	PLYWOOD	
EA EA	EACH			
E.C.	ELECTRICAL CONTRACTOR	PR	PAIR	
ELEC.	ELECTRICAL	PT	PAINTED	
ELEV	ELEVATION/ELEVATOR	RAD	RADIUS	
E.F.	EACH FACE	REINF	REINFORCED	
EQ	EQUAL	PEO'D	PEOLIBED	
EQUIP	EQUIPMENT	NEQU	REQ'D REQUIRED	
EXG.	EXISTING	RESIL	ESIL RESILIENT	
EXP.	EXPANSION	RM.	ROOM	
E.W.	EACH WAY	R.O.	ROUGH OPENING	
E.W.C.	ELECTICAL WATER			
F.B.O.	COOLER FURNISHED BY OTHERS	SIM.	SIMILAR	
FD	FLOOR DRAIN	SHTG	SHEATHING	
FE	FIRE EXTINGUISHER	SPEC'S	S SPECIFICATIONS	
FDN	FOUNDATION		SPECIFICATIONS	
FLR	FLOOR	SQ.	SQUARE	
FIN.	FINISH(ED)	STD.	STANDARD	
FTG	FOOTING	STL	STEEL	
FURR	FURRING	STRUCT	STRUCTURAL	
GA.	GAUGE		STROUTOINAL	
GV.	GALVANIZED	SUSP. CLG.	SUSPENDED CEILING	
GL	GLASS	T.O.B.	TOP OF BEAM	
GRD	GRADE	1.U.B.	TOF OF DEAIVI	
GPDW	GYPSUM DRYWALL	T.M	TOP OF MASONRY	
GYP	GYPSUM	TOB	TOP OF PIDGE	
H.A.C.	HEATING AND A/C	T.O.R	TOP OF RIDGE	
HDWD	CONTRACTOR HARD WOOD	T.O.P.	TOP OF PLATE	
H.M.	HARD WOOD HOLLOW METAL	T 0 0		
H.M. HORIZ	HOLLOW METAL HORIZONTAL	T.O.S.	TOP OF STEEL	
		TYP.	TYPICAL	
H.P.	HIGH POINT			
HT. I.D.T.	INSIDE DIMENSION CLEAR	U.N.O.	UNLESS NOTED OTHERWISE	
I.D. I . I.D.	INSIDE DIMENSION CLEAR	VCT	VINYL COMPOSITION TILE	
I.D. INSUL	INSULATION	W/	WITH	

DEMOLITION AND DISPOSAL

- 1. PROTECT WALLS, CEILINGS, FLOORS, AND OTHER EXISTING FINISH WORK THAT ARE TO REMAIN AND ARE EXPOSED DURING SELECTIVE DEMOLITION
- 2. PROVIDE AND MAINTAIN INTERIOR AND EXTERIOR SHORING, BRACING, OR STRUCTURAL SUPPORT TO PRESERVE STABILITY AND PREVENT MOVEMENT & SETTLEMENT
- 3. CLEAN ADJACENT STRUCTURES AND IMPROVEMENTS OF DUST, DIRT, AND DEBRIS CAUSED BY SELECTIVE DEMOLITION OPERATIONS. RETURN ADJACENT AREAS TO CONDITION EXISTING PRIOR TO START OF SELECTIVE DEMOLITION.
- 4. DEMOLISH AND REMOVE EXISTING CONSTRUCTION ONLY TO THE EXTENT REQUIRED BY NEW CONSTRUCTION.
- 5. PROMPTLY PATCH AND REPAIR HOLES AND DAMAGED SURFACES CAUSED TO ADJACENT CONSTRUCTION BY SELECTIVE DEMOLITION OPERATIONS.
- 6. WHERE REPAIRS TO EXISTING SURFACES ARE REQUIRED, PATCH TO PRODUCE SURFACES SUITABLE FOR NEW MATERIALS. 7. RESTORE EXPOSED FINISHES OF PATCHED AREAS AND EXTEND FINISH
- RESTORATION INTO ADJOINING CONSTRUCTION TO REMAIN IN A MANNER THAT ELIMINATES EVIDENCE OF PATCHING AND REFINISHING.
- 8. PATCH AND REPAIR FLOOR AND WALL SURFACES IN THE NEW SPACE WHERE DEMOLISHED WALLS OR PARTITIONS EXTEND ONE FINISHED AREA INTO ANOTHER. PROVIDE A FLUSH AND EVEN SURFACE OF UNIFORM
- COLOR AND APPEARANCE. 9. PATCH, REPAIR, OR REHANG EXISTING CEILINGS AS NECESSARY TO
- PROVIDE AN EVEN-PLANE SURFACE OF UNIFORM APPEARANCE. 10. DISPOSAL: PROMPTLY DISPOSE OF DEMOLISHED MATERIALS. DO NOT ALLOW DEMOLISHED MATERIALS TO ACCUMULATE ON-SITE.
- a) DO NOT BURN DEMOLISHED MATERIALS b) TRANSPORT DEMOLISHED MATERIALS OFF OF OWNER'S PROPERTY AND LEGALLY DISPOSE OF THEM.

STRUCTURAL SPECIFICATIONS AND NOTES

- a. CAST-IN-PLACE CONCRETE DESIGN MIX TO PROVIDE 3,500 PSI 28 DAY COMPRESSIVE STRENGTH
- b. PORTLAND CEMENT: ASM C150, TYPE 1
- c. AGGREGATE: NORMAL WEIGHT AGGREGATES, ASM C33 d. BARS: DEFORMED STEEL, ASTM A615, GRADE 60.
- e. MESH: WELDED STEEL WIRE FABRIC ASTM A185 1) FOR SLAB ON GRADE APPLICATIONS, FIBROUS REINFORCEMENT CAN BE SUBSTITUTED
 - FOR WELDED WIRE FABRIC 2) ALL MESH MUST BE PROPERLY SUPPORTED ON CHAIRS PRIOR TO POURING CONCRETE. CONTRACTOR MAY NOT HOOK AND PULL MESH INTO PROPER PLACEMENT.
- f. FIBROUS REINFORCEMENT: "FIBERMESH 150" OR EQUIVALENT
- g. AIR ENTRAINMENT: ASTM C260. AIR ENTRAIN ALL EXTERIOR CONCRETE
- h. SLAB CONTROL JOINTS: SAW CUT OR FORM TO 1/3 SLAB DEPTH. CONTROL JOINTS TO BE
- SPACED @ 20'-0" O.C. MAX. U.N.O.
- i. SLAB ISOLATION JOINTS: PRE-MOLDED JOINT FILLER j. COMPLY WITH ACI 301, 304, 305, 306, 311, 318, 347. CRSI "MANUAL OF STANDARD PRACTICE, AND
- ASTM C94. CALCIUM CHLORIDE ADMIXTURES ARE NOT PERMITED. ALL SUBGRADE TO SUPPORT CAST IN PLACE SLABS TO BE COMPACTED TO 95% COMPACTION
- STANDARD MINIMUM. BOTTOM OF ALL FOOTINGS SHALL BE A MINIMUM OF 32" BELOW FINISH GRADE OR PER APPLICABLE BUILDING CODE FOR THIS PROJECT (USE GREATER OF THE TWO CONDITIONS). FOOTINGS TO BE PLACED ON UNDISTURBED SOIL OR ENGINEERED FILL TO BE DESIGNED BY LICENSED GEOTECHNICAL
- OR STRUCTURAL ENGINEER. FOR BASIS OF DESIGN, ASSUMED SOIL BEARING CAPACITY OF 2,000 PSF AND WATER TABLE BELOW FROST LINE. CONTRACTOR OR CLIENT TO OBTAIN GEOTECHNICAL ENGINEERS SITE REPORT TO
- VERIFY DESIGN ASSUMPTIONS. MASONRY SPECIFICATIONS: COMPLY WITH AMERICAN CONCRETE INSTITUTE ACI 531.11
- "SPECIFICATION FOR CONCRETE MASONRY CONSTRUCTION" (LATEST EDITION)
- a. HOLLOW LOAD BEARING: ASM C90 GRADE N, TYPE 1 UNITS. b. COMPRESSIVE STRENGTH: FM = 1500 PSI MIN.
- c. MORTAR: ASTM C270 TYPE S. PROVIDE FULLY BEDDED JOINTS. d. GROUT: ASTM C476 OR 3000 PSI CONCRETE WITH PEA GRAVEL PER CONCRETE
- SPECIFICATIONS. e. REINFORCING STEEL: ASTM A615 60 KSI DEFORMED BARS. STRUCTURAL STEEL: COMPLY WITH AMERICAN INSTITUTE OF STEEL CONSTRUCTION "SPECIFICATION
- FOR THE DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS" (LATEST

PROVIDE HARD, SMOOTH

NONABSORBENT FINISHES

WITH 24" OF TOILET TO A

3'-0" MIN.

2'-0" MIN.

1'-0" MAX.

1 1/2 "Ø GRASPABLE HANDRAIL

GUARDRAIL -

MIN. HEIGHT OF 48"

a. STEEL SHAPES AND PLATES: ASTM A36

4'-6" MIN.

3'-6" MIN.

b. STEEL PIPE: ASTM A53, TYPE E OR S, GRADE B SCHEDULE 40 c. FASTENERS: ASTM A325N

39"-41"

1'-0" MAX.

PROTRUD**I**NG

24" MIN.

42" MAX.

ACCESSIBLE TOILET GRAB BAR SIDE ELEVATION

5'-0" CLEAR MIN.

PROVIDE SPACE FOR

ADA DETAILS

3/₄" = 1'-0"

4" MAX. CLEARSPACE BETWEEN BALUSTERS

(MIN.)

DISPENSER

OUTLET LOCATION

- d. ANCHOR BOLTS: ASTM A307
- e. PRIMER PAINT: FABRICATOR'S STANDARD RUST INHIBITING PRIMER.
- f. STRUCTURAL TUBING: ASTM A500 GR. B g. PROVIDE A MINIMUM 3/8" THICK FULL DEPTH THRU-PLATE FOR ALL PIPE AND TUBE COLUMN
- CONNECTIONS h. DESIGN CONNECTIONS FOR THE MINIMUM SHEAR CAPACITIES NOTED IN THE AISC BEAM TABLES
- OR FOR THE REACTIONS SHOWN ON THE DRAWINGS, WHICHEVER IS GREATER. i. GALVANIZE: ASTM A123 FOR SHAPES AND ASSEMBLIES, ASTM A153 FOR FASTENERS. USE GALVANIZED FASTENERS WHEN CONNECTING GALVANIZED MEMBERS.
- j. WELDS: COMPLY WITH AWS D1.1 "STRUCTURAL WELDING CODE" k. PUNCH HOLES IN ALL STEEL BEAMS (BOTH FLANGES AND WEBS) FOR BOLTING OF WOOD BLOCKING (9/16"Ø HOLES AT 24" O.C. STAGGERED PLUS (2) AT 3" FROM EACH END.)
- I. UNLESS NOTED OTHERWISE, PROVIDE BUILT-UP 2X WD. COLUMN TO MATCH WIDTH OR FLANGE UNDER EACH END OF EACH STEEL BEAM. COLUMN TO MATCH WALL THICKNESS. CONNECT
- PROVIDE FULL BEARING BENEATH STEEL BEAM, BUILD OUT REQUIRED COLUMN AS REQUIRED FOR WOOD OR PROVIDE STEEL BEARING PLATE FOR STEEL CONNECTIONS. 7. ROUGH CARPENTRY SPECIFICATIONS: COMPLY WITH THE NATIONAL FOREST PRODUCTS
- ASSOCIATION (NFPA) "NATIONAL DESIGN SPECIFICATION FOR WOOD" (LATEST EDITION) a. WOOD FRAMING: #2 SPRUCE-PINE-FIR OR BETTER, FINISHED 4 SIDES WITH 19% MAX. MOISTURE

STEEL TO POST WITH (2) 1/2"Ø BOLTS AND WELDED STEEL PLATES AS NECESSARY. ALWAYS

- b. WOOD FOR NAILERS, BLOCKING, FURRING, AND SLEEPERS: CONSTRUCTION GRADE, FINISHED 4 SIDES WITH 19% MAX. MOISTURE CONTENT. PRESSURE PRESERVATIVE TREAT ALL ITEMS IN CONTACT WITH ROOFING, FLASHING, WATERPROOFING, MASONRY, CONCRETE, OR THE GROUND. PROVIDE BLOCKING FOR ALL WALL MOUNTED ITEMS.
- c. PLYWOOD: APA RATED FOR USE AND EXPOSURE: 1) SUBFLOOR: APA SHEATHING, 3/4" TONGUE AND GROOVE (T&G)
- 2) WALL SHEATHING: APA SHEATHING, C-D PLUGGED, 1/2" MIN. EXTERIOR. 3) ROOF SHEATHING: APA SHEATHING, 1/2" MIN. EXTERIOR. PROVIDE 5/8" IF RAFTER OR TRUSSES ARE SPACED @ 24" O.C.
- d. WOOD TREATMENT: #2 SPRUCE PINE FIR PRESSURE IMPREGNATED WITH MICRONIZED COPPER PRESERVATIVE SYSTEM IN ACCORDANCE WITH ICC ESR-2325 STANDARDS AND DRIED TO A MOISTURE CONTENT OF 19%.
- e. ALL EXTERIOR FASTENERS FOR TREATED WOOD TO CONFORM TO ASTM A153 OR EQUIVALENT f. ALL HARDWARE (CONNECTORS, JOIST HANGERS, ETC.) FOR TREATED WOOD TO CONFORM TO ASTM-A653 G90
- q. WOOD FRAMING TO COMPLY WITH RECOMMENDATIONS OF NFPA MANUAL FOR HOUSE FRAMING. NFPA RECOMMENDED NAILING SCHEDULE, AND NFPA NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION.

11" MIN. KNEE CLEARANCE

1'-5" MIN. TOE CLEARANCE

MAX.

ACCESSIBLE TOILET GRAB BAR REAR ELEVATION ACCESSIBLE TOILET LAVATORY CLEARANCES ACCESSIBLE URINAL MOUNTING HEIGHTS

ROLL-IN TYPE SHOWER WITHOUT SEAT

MAX.

8. PROVIDE BLOCKING OR DOUBLE FLOOR JOIST UNDER ALL WALLS PARALLEL TO JOISTS.

- 9. PROVIDE SOLID BRIDGING AT MID-SPAN FOR JOISTS 10' OR GREATER IN LENGTH.
- 10. PROVIDE DOUBLE JOISTS AROUND ALL FLOOR AND ROOF OPENINGS (UNLESS NOTED OTHERWISE). 11. ENGINEERED WOOD BEAMS: MANUFACTURE AND INSTALL IN ACCORDANCE WITH WRITTEN SPECIFICATIONS BY "ILEVEL" OR EQUIVALENT
 - a) MINIMUM DESIGN STRESSES: 1) LSL BEAMS: FB: 2600 PSI, FV: 400 PSI, E: 1,700,000 PSI
 - 2) LVL BEAMS: FB: 2600 PSI, FV: 285 PSI, E: 1,900,000 PSI
 - 3) PSL BEAMS: FB: 2900 PSI, FV: 290 PSI, E: 2,000,000 PSI 4) WOLM. PSL BEAMS: FB: 1600 PSI, FV: 170 PSI, E: 1,300,000 PSI.
 - 5) GLU-LAM BEAMS: Fb: 1600 PSI, FV170 PSI, E: 1,300,000 PSI 5) PSL COLUMNS: FC: 2500 PSI, FB: 2400 PSI, E: 1,800,000 PSI.
 - 6) WOLM. PSL COLUMNS: FC: 1300 PSI, FV: 1500 PSI, E: 1,300,000 PSI b) MANUFACTURER TO PROVIDE AND DESIGN ALL BEAM TO BEAM AND BEAM TO COLUMN
 - CONNECTIONS (U.N.O.) c) ALL MULTI-PLY BEAMS TO BE BOLTED WITH 5/8"Ø BOLTS @ 16" O.C. STAGGERED OR
- EQUIVALENT METHOD PER MANUFACTURER'S SPECIFICATIONS 12. ENGINEERED WD.-I JOISTS: ALL JOISTS TO MEET APA REQUIREMENTS. CONTRACTOR IS
- RESPONSIBLE FOR PROVIDING ALL SHEAR BLOCKING, WEB REINFORCEMENT, CRUSH BLOCKS, ETC PER MANUFACTURER'S SPECIFICATIONS FOR ALL POINT LOADS AND CANTILEVERS. CONTACT ARCHITECT AS REQUIRED FOR CLARIFICATIONS OF ANY SPECIAL LOADING CONDITIONS. 13. TYPICAL HEADERS U.N.O.:

17"-19"

MIN.

ACCESSIBLE DRINKING FOUNTAIN

HEIGHTS AND CLEARANCES

SHOWER CONTROLS

CAN BE LOCATED ON

ROLL IN SHOWER REAR WALL ELEVATION

ANY WALL OF SHOWER

42" HIGH GUARDRAIL

 $2\frac{1}{4}$ " (TYP.)

- 1½"Ø HANDRAIL

36" A.F.F.

3'-1" MIN.

2x4 WD. STUD WALLS; (2) 2x10 WD. MIN. 2x6 WD. STUD WALLS: (3) 2x10 WD. MIN.

13 1/2" MIN.

PROVIDE HARD, SMOOTH,

MIN. HEIGHT OF 48"

NONABSORBENT FINISHES WITH 24" OF URINAL TO A

BEAM SUPPORT SCHEDULE					
CALLOUT	SIZE OF POST	POST CAP	POST BASE		
P1	(3) 2x4 WD. POST				
P2	(4) 2x4 WD. POST				
P3	(5) 2x4 WD. POST				
P4	(3) 2x6 WD. POST				
P5	(4) 2x6 WD. POST				
P6	(5) 2x6 WD. POST				
P7	3 ½"x 5 ¼ PSL POST				
P8	5 ¼"x5 ¼" PSL POST				
P9	3 ½"x7" PSL POST				
P10	6x6 P.T. WD.	BCS2-3/6z	ABW6ZZ		

SITE MAP

PROJECT SITE



FOUNDATION PLAN FLOOR PLAN FRONT ELEVATION AND REAR ELEVATION SIDE ELEVATIONS **BUILDING SECTION** BUILDING SECTION BUILDING SECTION

PROJECT DATA

SHEET INDEX

ROOF PLAN

ARCHITECT ARCHOLOGY 107 S. WASHINGTON ST. MILFORD, DELAWARE 19963 (302) 339-5566

A-1.01

A-1.02

A-1.03

A-2.01

A-2.02

A-3.01

A-3.02

A-3.03

WATER DISPENSING

FRONT

HAND OPERATED

CONTROLS ON

ALL WORK TO COMPLY WITH THE FOLLOWING CODES AS ADOPTED BY THE **COUNTY OF KENT:**

INTERNATIONAL BUILDING CODE 2018 INTERNATIONAL EXISTING BUILDING CODE 2018 NFPA 101 LIFE SAFETY CODE (2021 EDITION) INTERNATIONAL ENERGY CONSERVATION CODE 2018 ICC/ANSI A117.1-17 ACCESSIBILITY STANDARDS INTERNATIONAL PLUMBING CODE 2021 NFPA 70 AND NEC (MOST RECENT EDITION) ELECTRICAL CODES INTERNATIONAL MECHANICAL CODE 2021

DESIGN LOADS FLOOR LIVE LOAD: 50 PSF FOR OFFICES,

100 PSF FOR CORRIDORS AND LOBBIES POINT LOAD OF 2000# ROOF LIVE LOAD: 25 PSF

ROOF SNOW LOAD: 20 PSF WIND SPEED: ASCE/7-22 RISK CATEGORY ii: 115 MPH.

SCOPE OF WORK: NEW CONSTRUCTION CHURCH

BUILDING CONSTRUCTION TYPE: Vb BUILDING IS NOT SPRINKLERED BUILDING IS NOT ALARMED

FIRE RESISTANCE RATING REQUIREMENTS FOR BUILDING ELEMENTS: PRIMARY STRUCTURAL FRAME: 0 HRS

EXTERIOR BEARING WALLS: 0 HRS INTERIOR BEARING WALLS: 0 HRS EXTERIOR NON-BEARING WALLS AND PARTITIONS: 0 HRS INTERIOR NON-BEARING WALLS AND PARTITIONS: 0 HRS FLOOR CONSTRUCTION AND ASSOCIATED SECONDARY MEMBERS: 0 HRS

ROOF CONSTRUCTION AND ASSOCIATED SECONDARY MEMBERS: 0 HRS

SQUARE FOOTAGE: CONDITIONED- 4,070± S.F. UNCONDITIONED FRONT ENTRY: 188± S.F.

ASSEMBLY: 613± S.F. / 7 S.F. PER OCCUPANT = 88 OCCUPANTS STAGE: 213± S.F. / 100 S.F. PER OCCUPANT = 3 OCCUPANTS KITCHEN: 191± S.F. / 200 S.F. PER OCCUPANT = 1 OCCUPANT OFFICE (BUSINESS): 430± S.F. / 150 S.F. PER OCCUPANT = 3 OCCUPANTS MECH/EQUIPMENT STORAGE: 218± S.F. / 300 S.F. PER OCCUPANT = 1

TOTAL OCCUPANTS = 116 OCCUPANTS EGRESS REQUIREMENTS: REQUIRED: 116 OCCUPANTS x .2" PER OCCUPANT = 23.2" (2) DOORS PROPOSED: 192" (5) DOORS

MAX. ALLOWABLE TRAVEL DISTANCE ALLOWED: 200'-0" MAX. TRAVEL DISTANCE PROPOSED: 70'-3"±

CLASSROOM AREA: 399± S.F. / 20 S.F. PER OCCUPANT = 20 OCCUPANTS

GENERAL NOTES

- 1. DO NOT SCALE THESE DRAWINGS. (VERIFY ALL DIMENSIONS IN THE FIELD PRIOR TO CONSTRUCTION.) 2. THE CONTRACTOR SHALL VERIFY ALL SITE CONDITIONS PRIOR TO
- CONSTRUCTION. 3. ALL DIMENSIONS ARE FROM FACE OF STUDS OR FACE OF MASONRY
- UNITS UNLESS NOTED OTHERWISE. 4. CONTRACTOR SHALL NOTIFY MISS UTILITY NOT LESS THAN TWO WORKING DAYS, NOT MORE THAN TEN WORKING DAYS, PRIOR TO
- EXCAVATION OR DEMOLITION ON THIS PROJECT. 5. ALL NEW MATERIALS SHALL BE FREE OF LEAD, ASBESTOS OR MERCURY
- 6. SHOULD ANY WORDS OR NUMBERS THAT ARE NECESSARY FOR A CLEAR UNDERSTANDING OF THE WORK BE ILLEGIBLE OR OMITTED OR SHOULD AN ERROR OR DISCREPANCY OCCUR IN ANY OF THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL NOT PROCEED WITH THAT PORTION OF THE WORK UNTIL CLARIFICATION IS RECEIVED. IN THE EVENT THE CONTRACTOR PROCEEDS WITHOUT SO NOTIFYING THE ARCHITECT, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE COST OF CORRECTING SAME, INCLUDING ANY RESULTING DAMAGE.
- . ALL FLOOR FINISHES TO BE CLASS I OR CLASS II. ALL FLOORING MATERIALS IN KITCHEN TO BE NON-POUROUS SURFACES. BATHROOM FLOORING TO EXTEND 6" UP WALL.
- 8. ALL WALL AND CEILING FINISHES TO BE CLASS A, CLASS B OR CLASS C. ALL WALL AND CEILING MATERIALS IN KITCHEN TO BE NON-POUROUSE CLEANABLE SURFACES. . ALL WALL HVAC SYSTEMS TO BE ELECTRIC NON-FUEL BURNING UNITS
- WITH LESS THAN 2,000 CFM 10. ALL DOOR HARDWARE TO BE ADA COMPATIBLE AND NON-KEYED FROM THE EGRESS SIDE

LICENSE NUMBER 25-0007352 EXPIRATION DATE 01/31/2026

PROFESSIONAL CERTIFICATION.

I CERTIFY THAT THESE DOCUMENTS

WERE PREPARED OR APPROVED BY ME,


AND THAT I AM A DULY LICENSED


ARCHITECT UNDER THE LAWS OF THE

STATE OF DELAWARE

SHEET#

60"Ø TURNING RADIUS DIM SET BY EXG. FIELD CONDITIONS. 1'-0" MIN. ON LANDING PER PLAN RAMP TO SLOPE 1" PER 12" MAX. **GUARD AND HANDRAIL DETAILS**

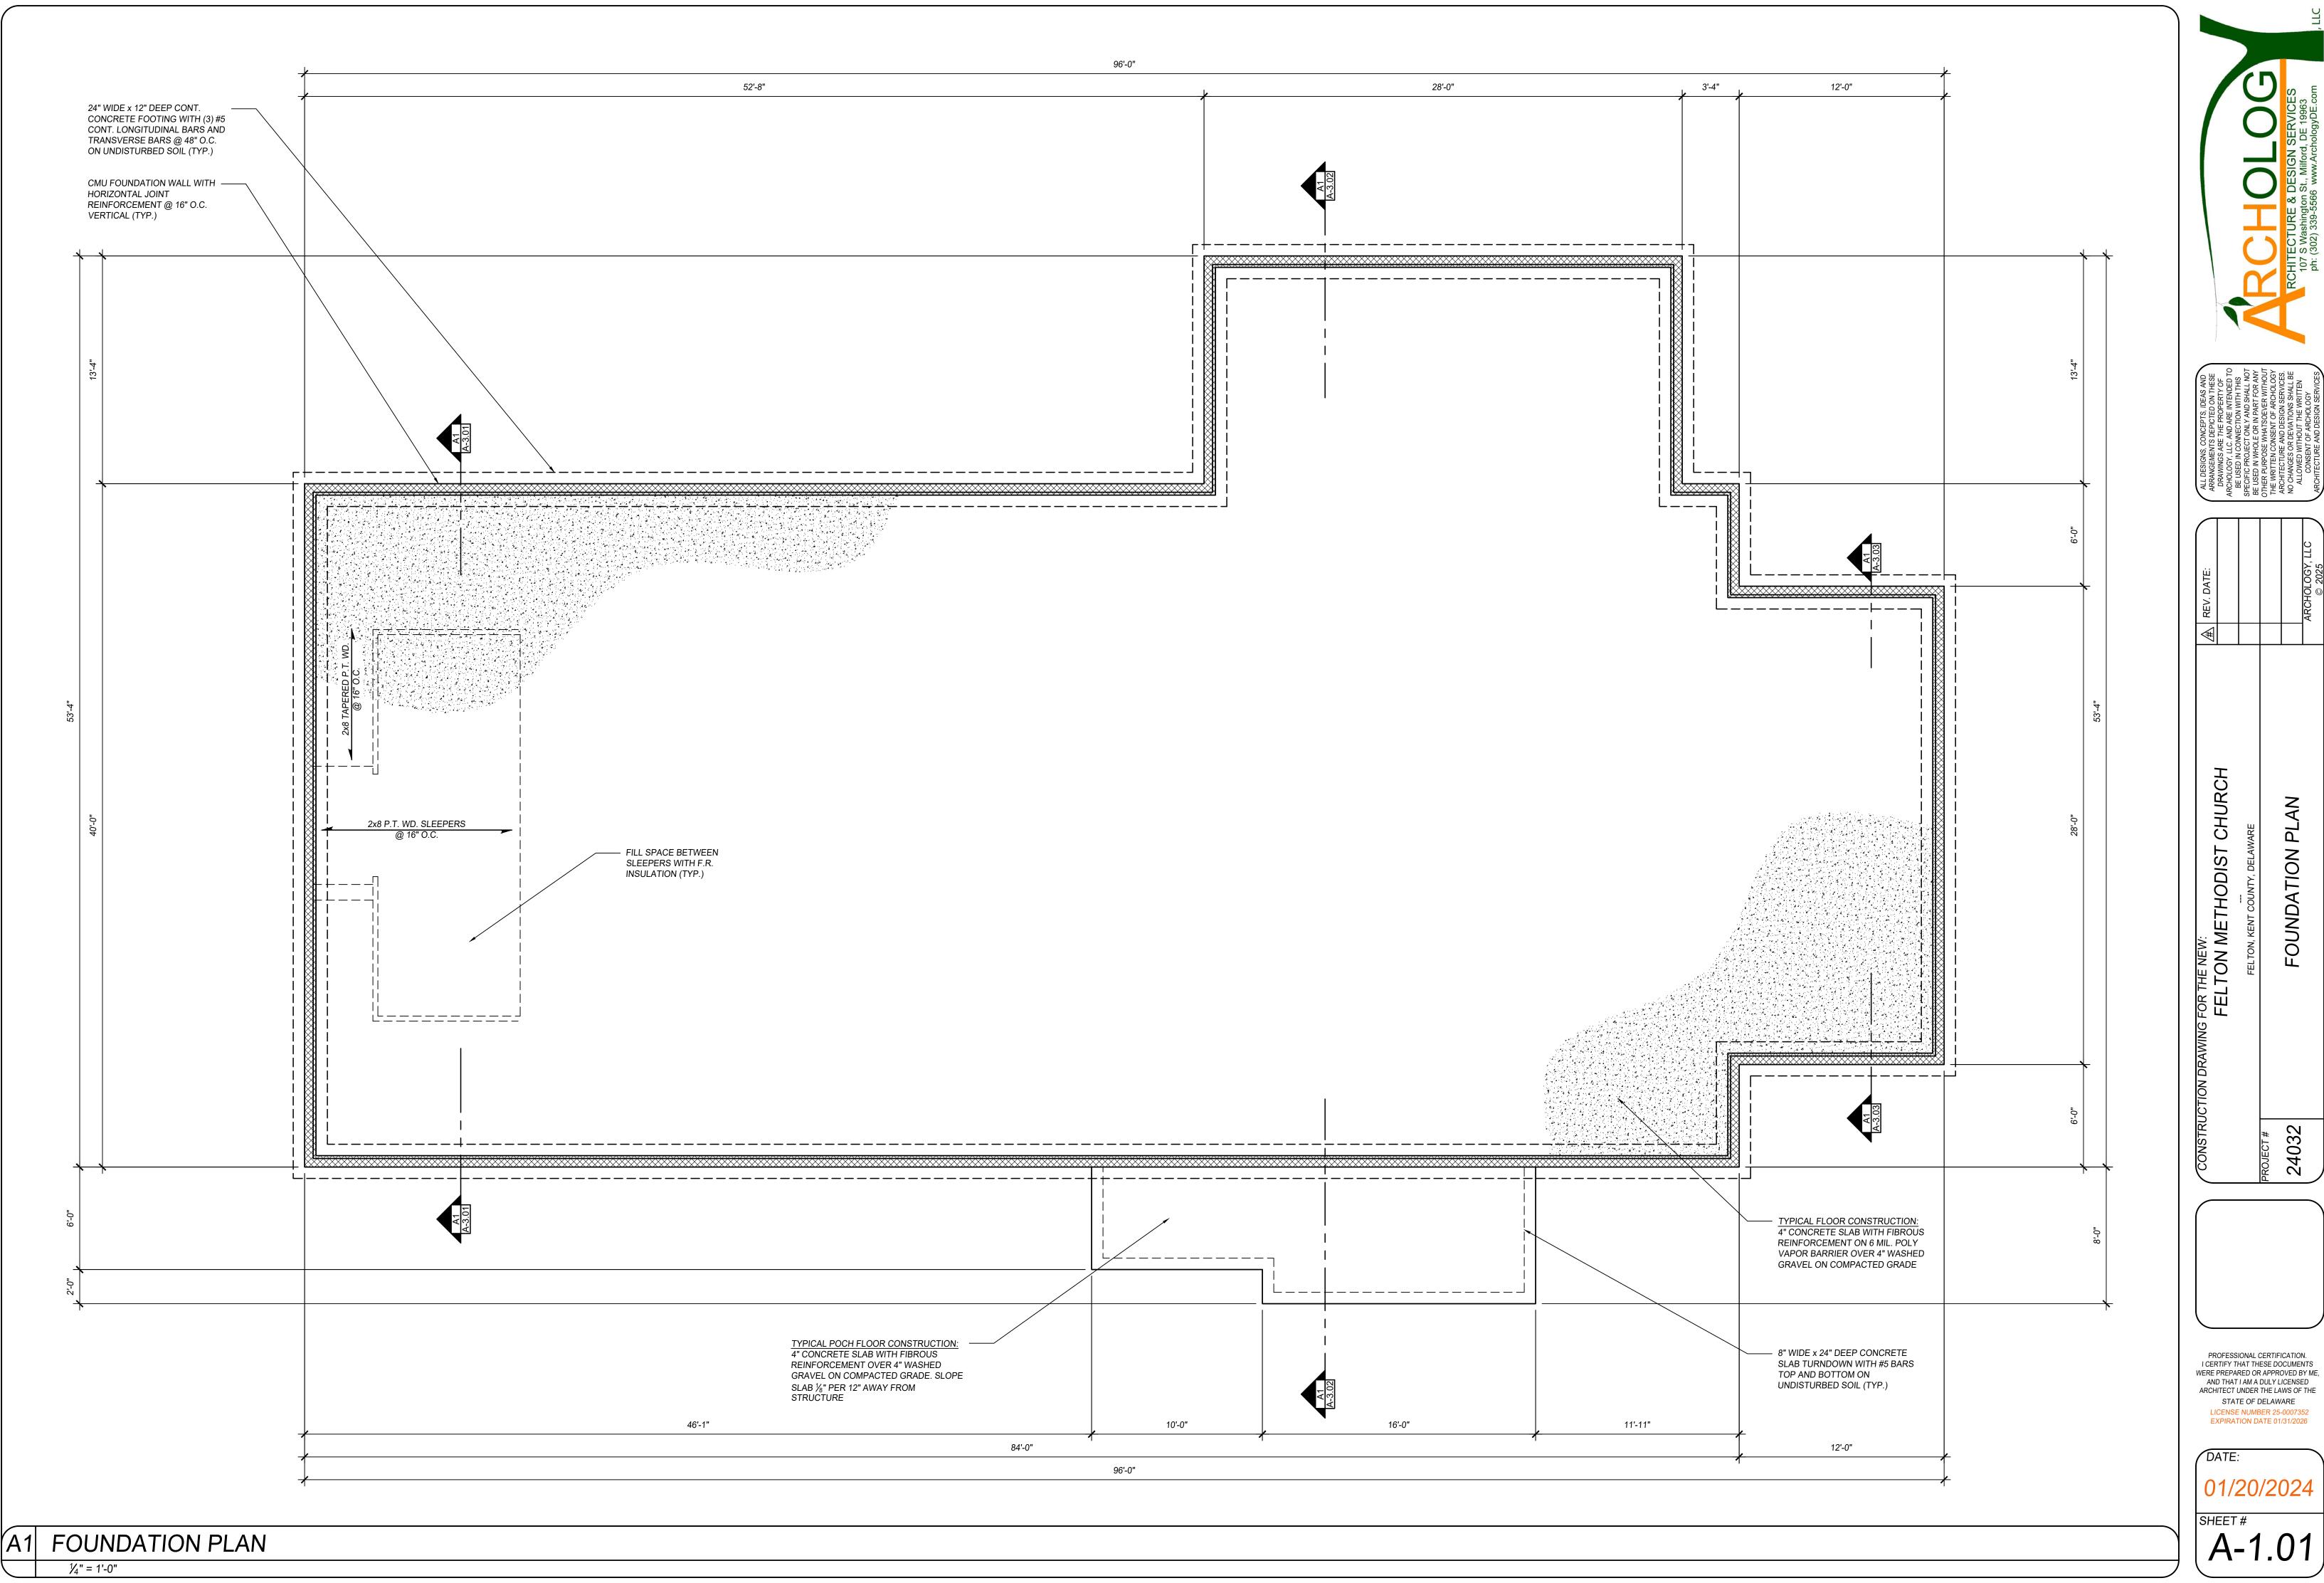

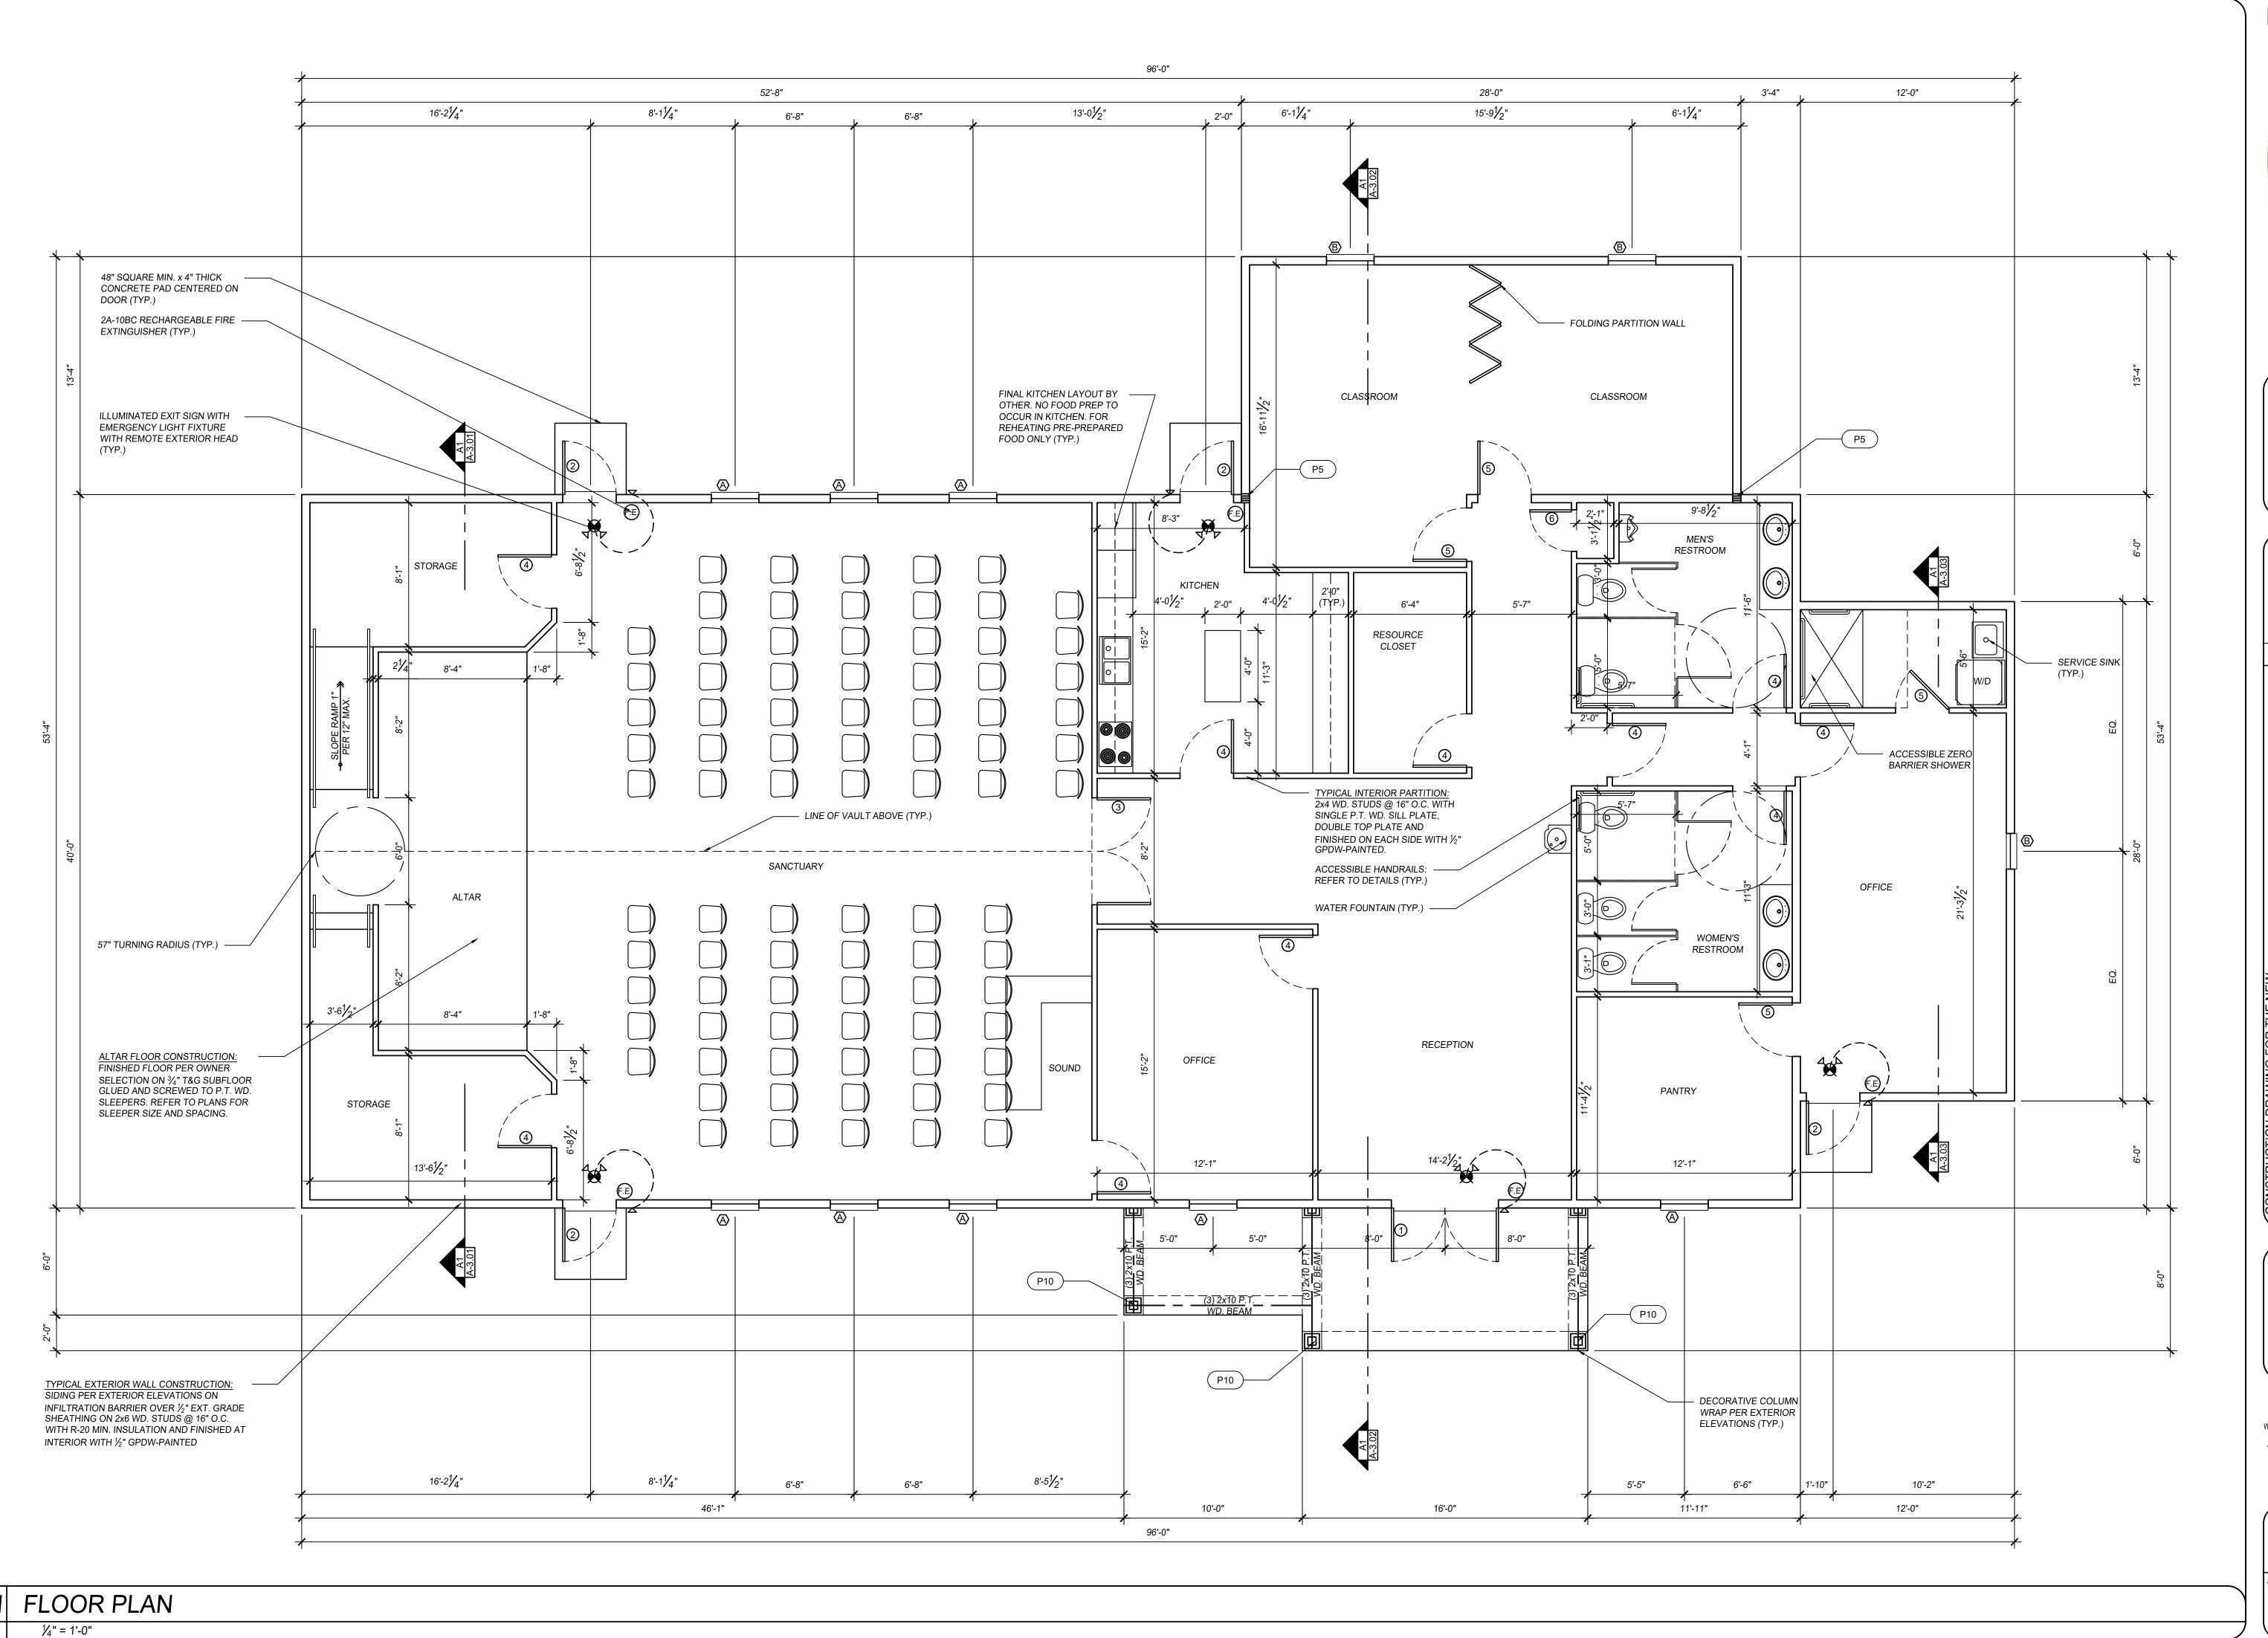

RCHITECTURE & DESIGN SERVICES
107 S Washington St., Milford, DE 19963
ph: (302) 339-5566 www.ArchologyDE.com, LLC

ALL DESIGNS, CONCEPTS, IDEAS AND ARRANGEMENTS DEPICTED ON THESE DRAWINGS ARE THE PROPERTY OF ARCHOLOGY, LLC. AND ARE INTENDED TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PURPOSE WHATSOEVER WITHOUT THE WRITTEN CONSENT OF ARCHOLOGY ARCHITECTURE AND DESIGN SERVICES.

NO CHANGES OR DEVIATIONS SHALL BE ALLOWED WITHOUT THE WRITTEN CONSENT OF ARCHOLOGY ARCHITECTURE AND DESIGN SERVICES.

NO CHANGES OR DEVIATIONS SHALL BE ALLOWED WITHOUT THE WRITTEN CONSENT OF ARCHOLOGY ARCHOLOGY AND CONSENT OF ARCHOLOGY AND COLUMBER AND DESIGN SERVICES.

FELTON METHODIST CHURCH

FELTON, KENT COUNTY, DELAWARE

FLOOR PLAN


PROFESSIONAL CERTIFICATION.
I CERTIFY THAT THESE DOCUMENTS
WERE PREPARED OR APPROVED BY ME,
AND THAT I AM A DULY LICENSED
ARCHITECT UNDER THE LAWS OF THE
STATE OF DELAWARE

LICENSE NUMBER 25-0007352 EXPIRATION DATE 01/31/2026

DATE: 01/20/202

HEET#


A-1.02

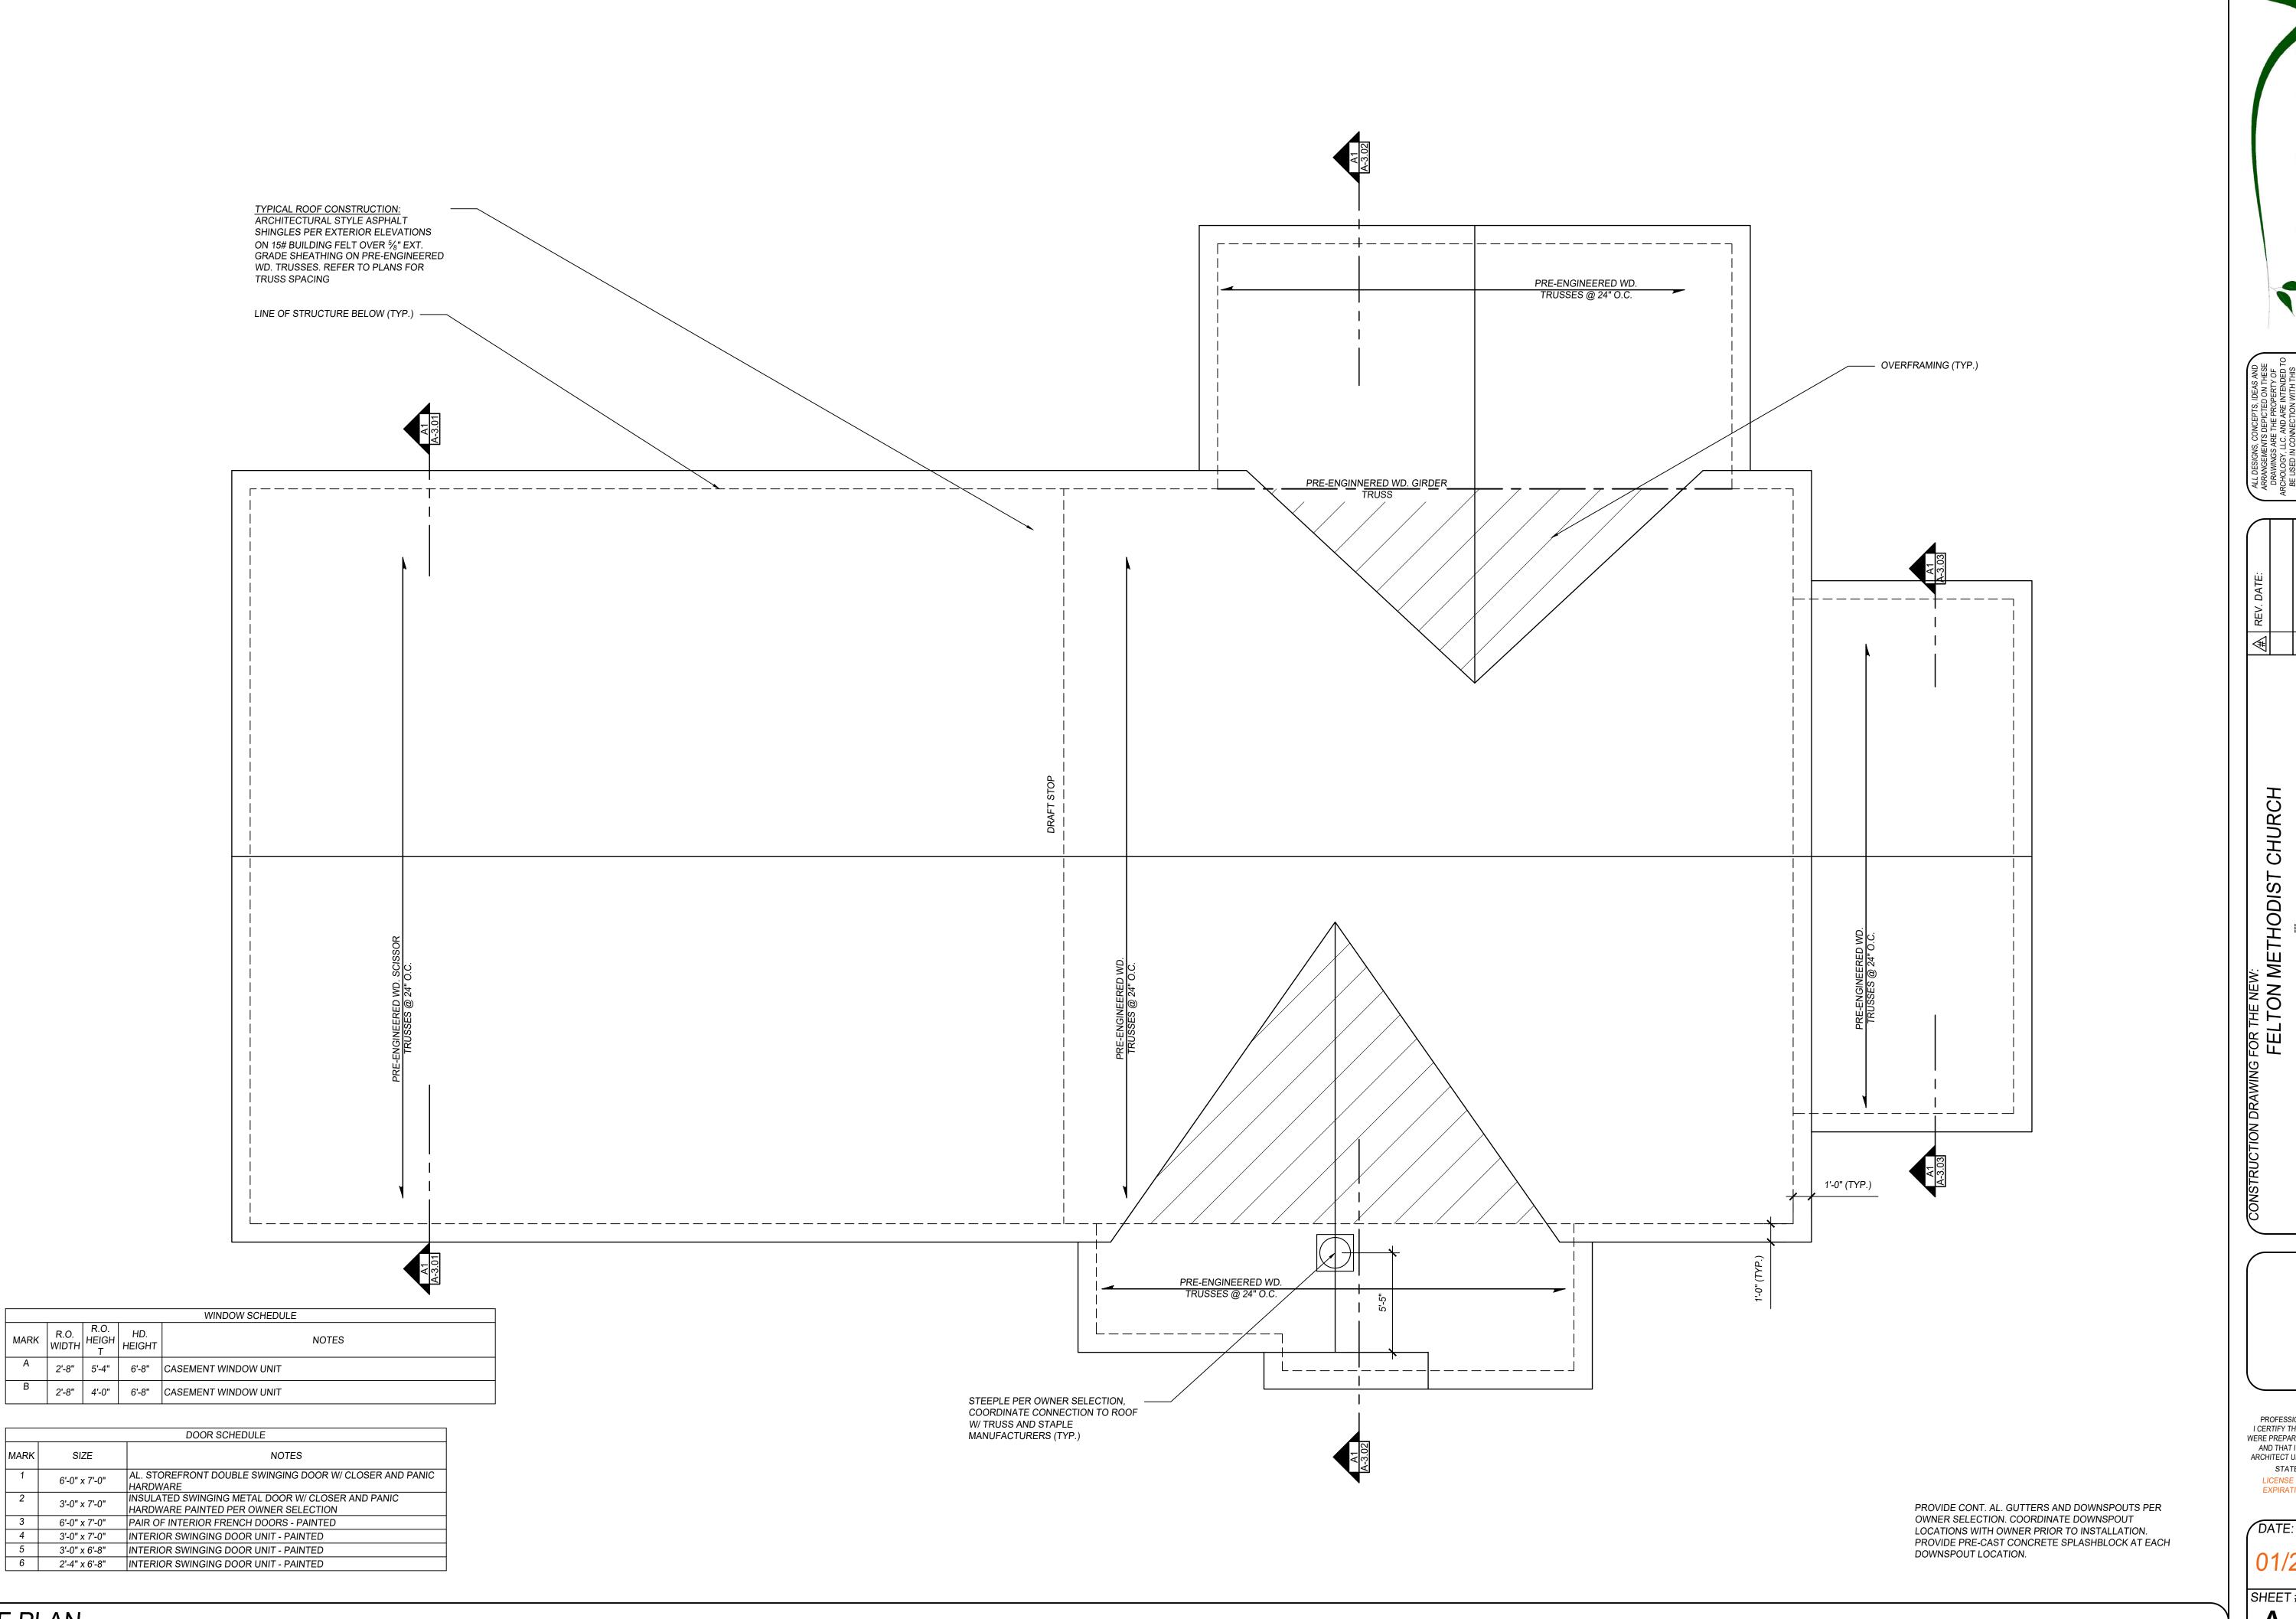


PROFESSIONAL CERTIFICATION.
I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED ARCHITECT UNDER THE LAWS OF THE STATE OF DELAWARE LICENSE NUMBER 25-0007352 EXPIRATION DATE 01/31/2026



PROFESSIONAL CERTIFICATION. I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED ARCHITECT UNDER THE LAWS OF THE STATE OF DELAWARE LICENSE NUMBER 25-0007352

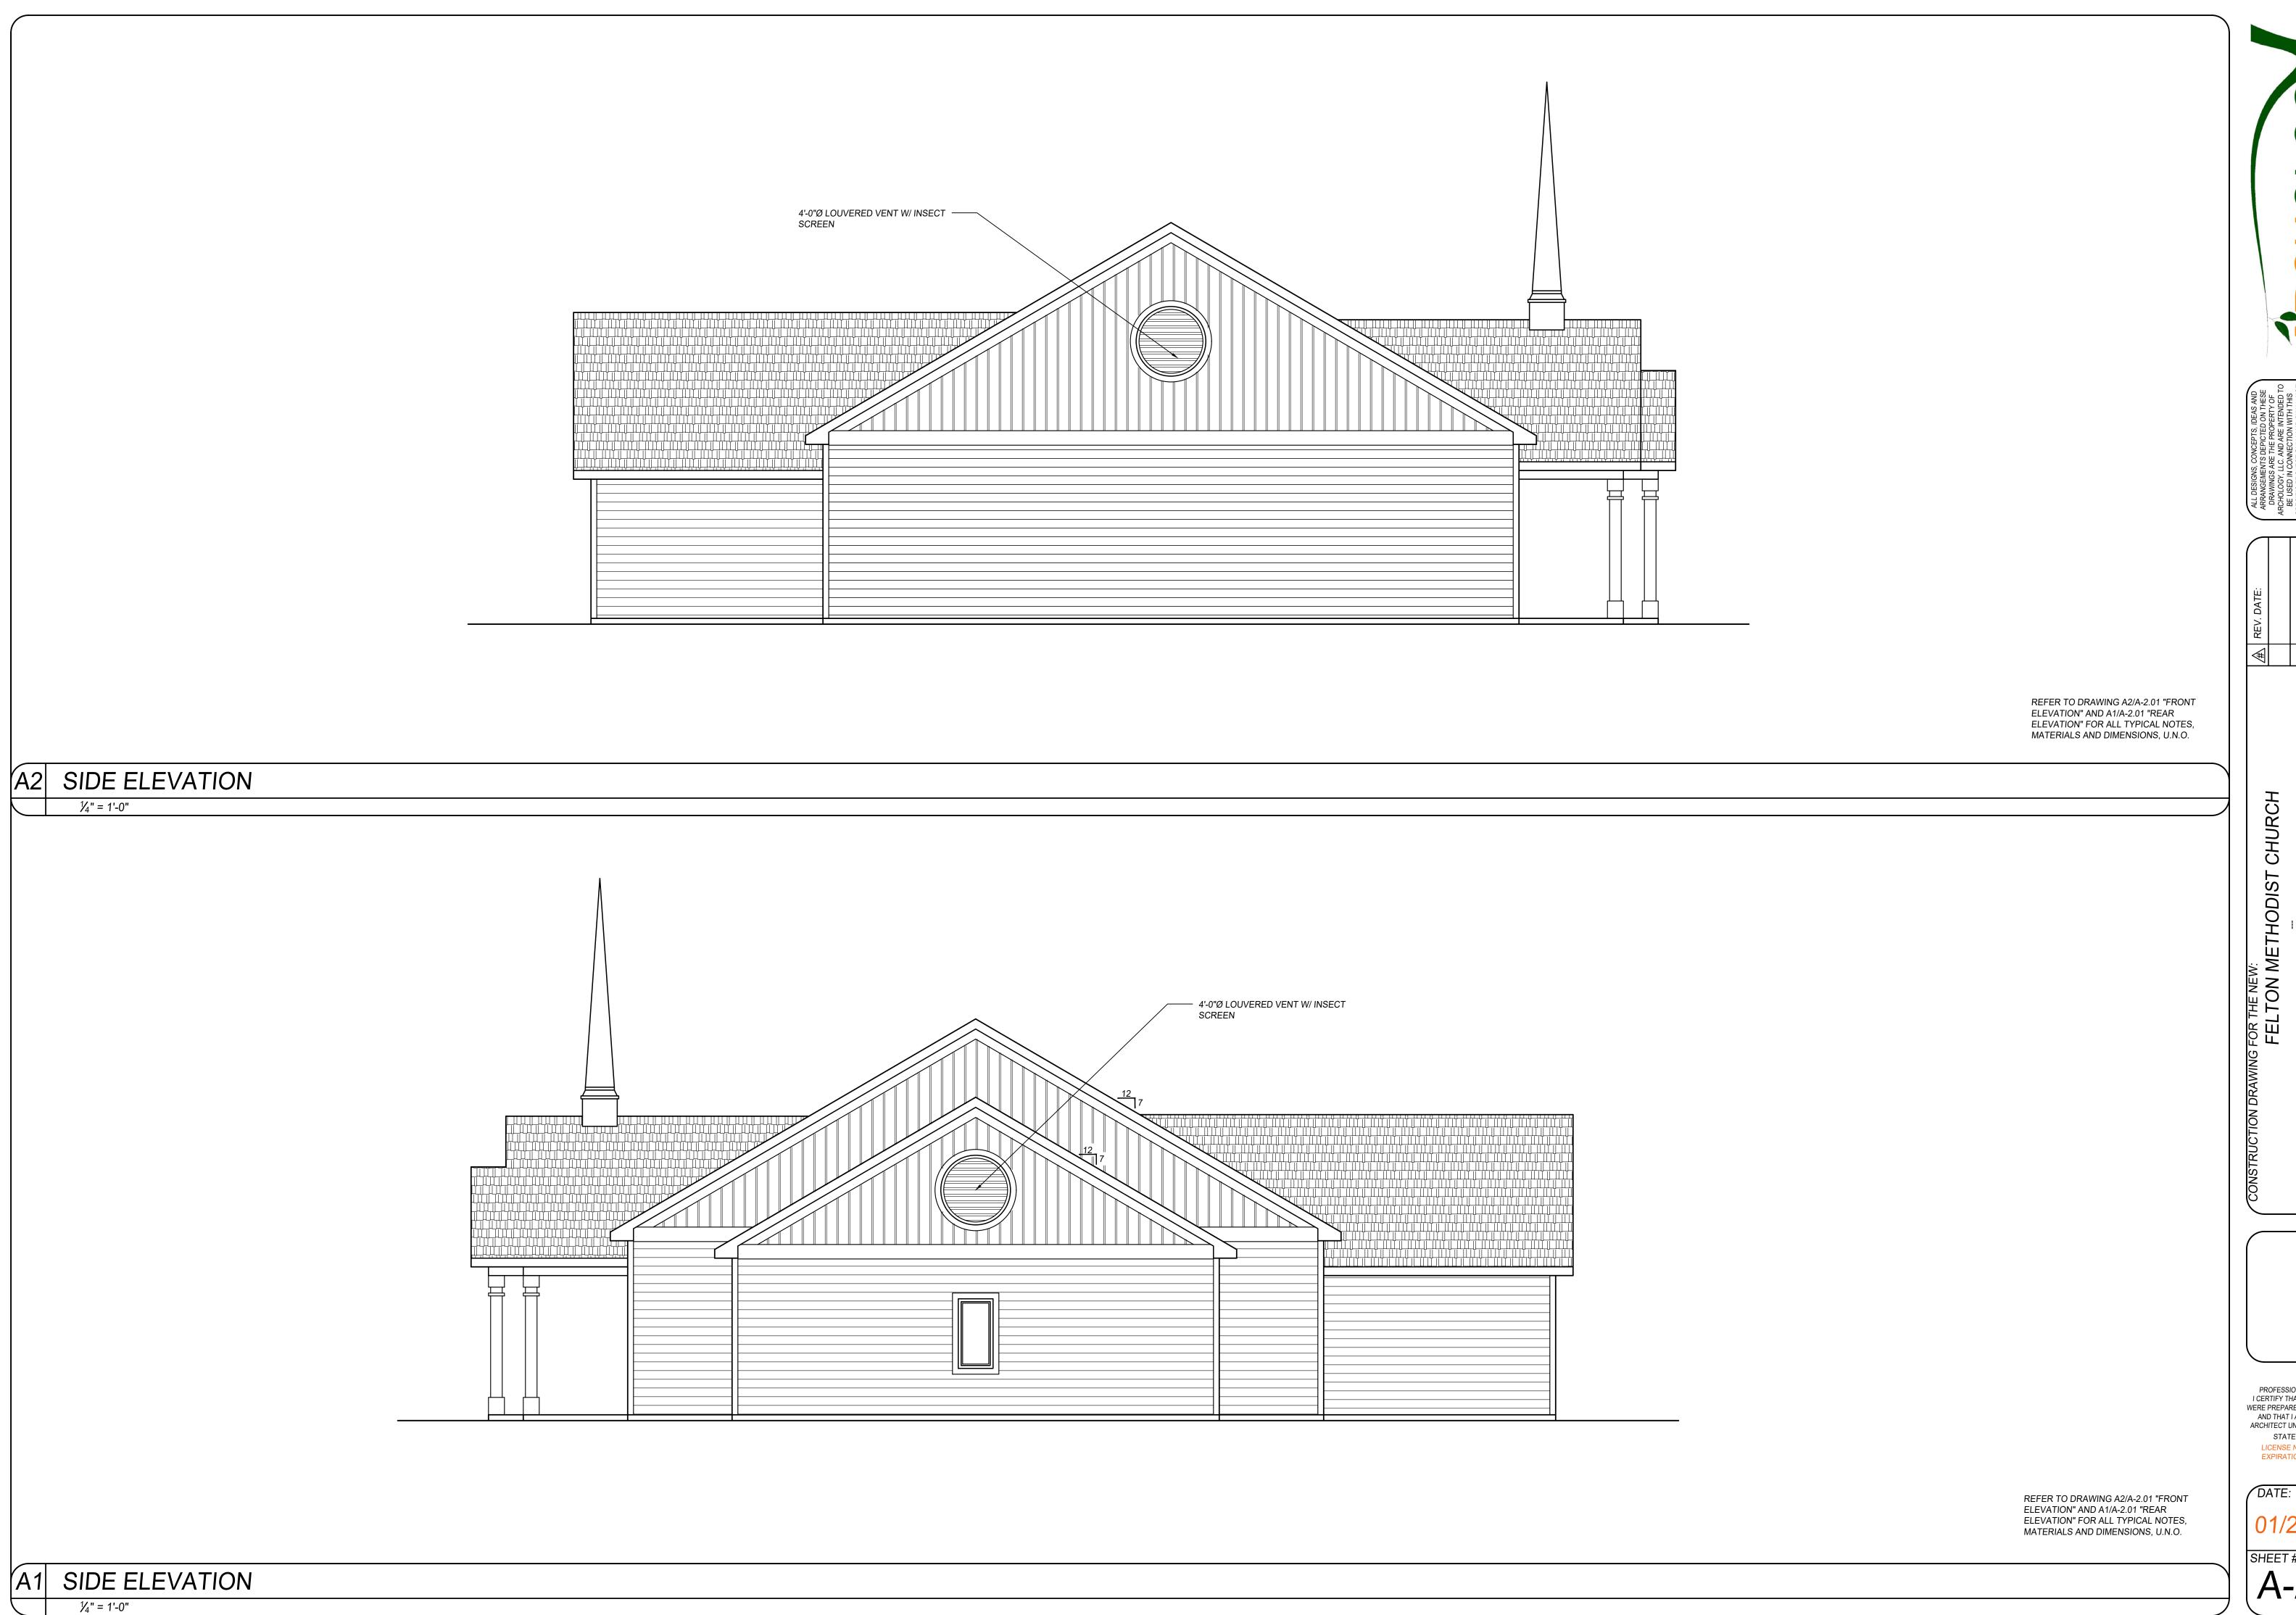


PROFESSIONAL CERTIFICATION.
I CERTIFY THAT THESE DOCUMENTS
WERE PREPARED OR APPROVED BY ME,
AND THAT I AM A DULY LICENSED
ARCHITECT UNDER THE LAWS OF THE STATE OF DELAWARE LICENSE NUMBER 25-0007352 EXPIRATION DATE 01/31/2026

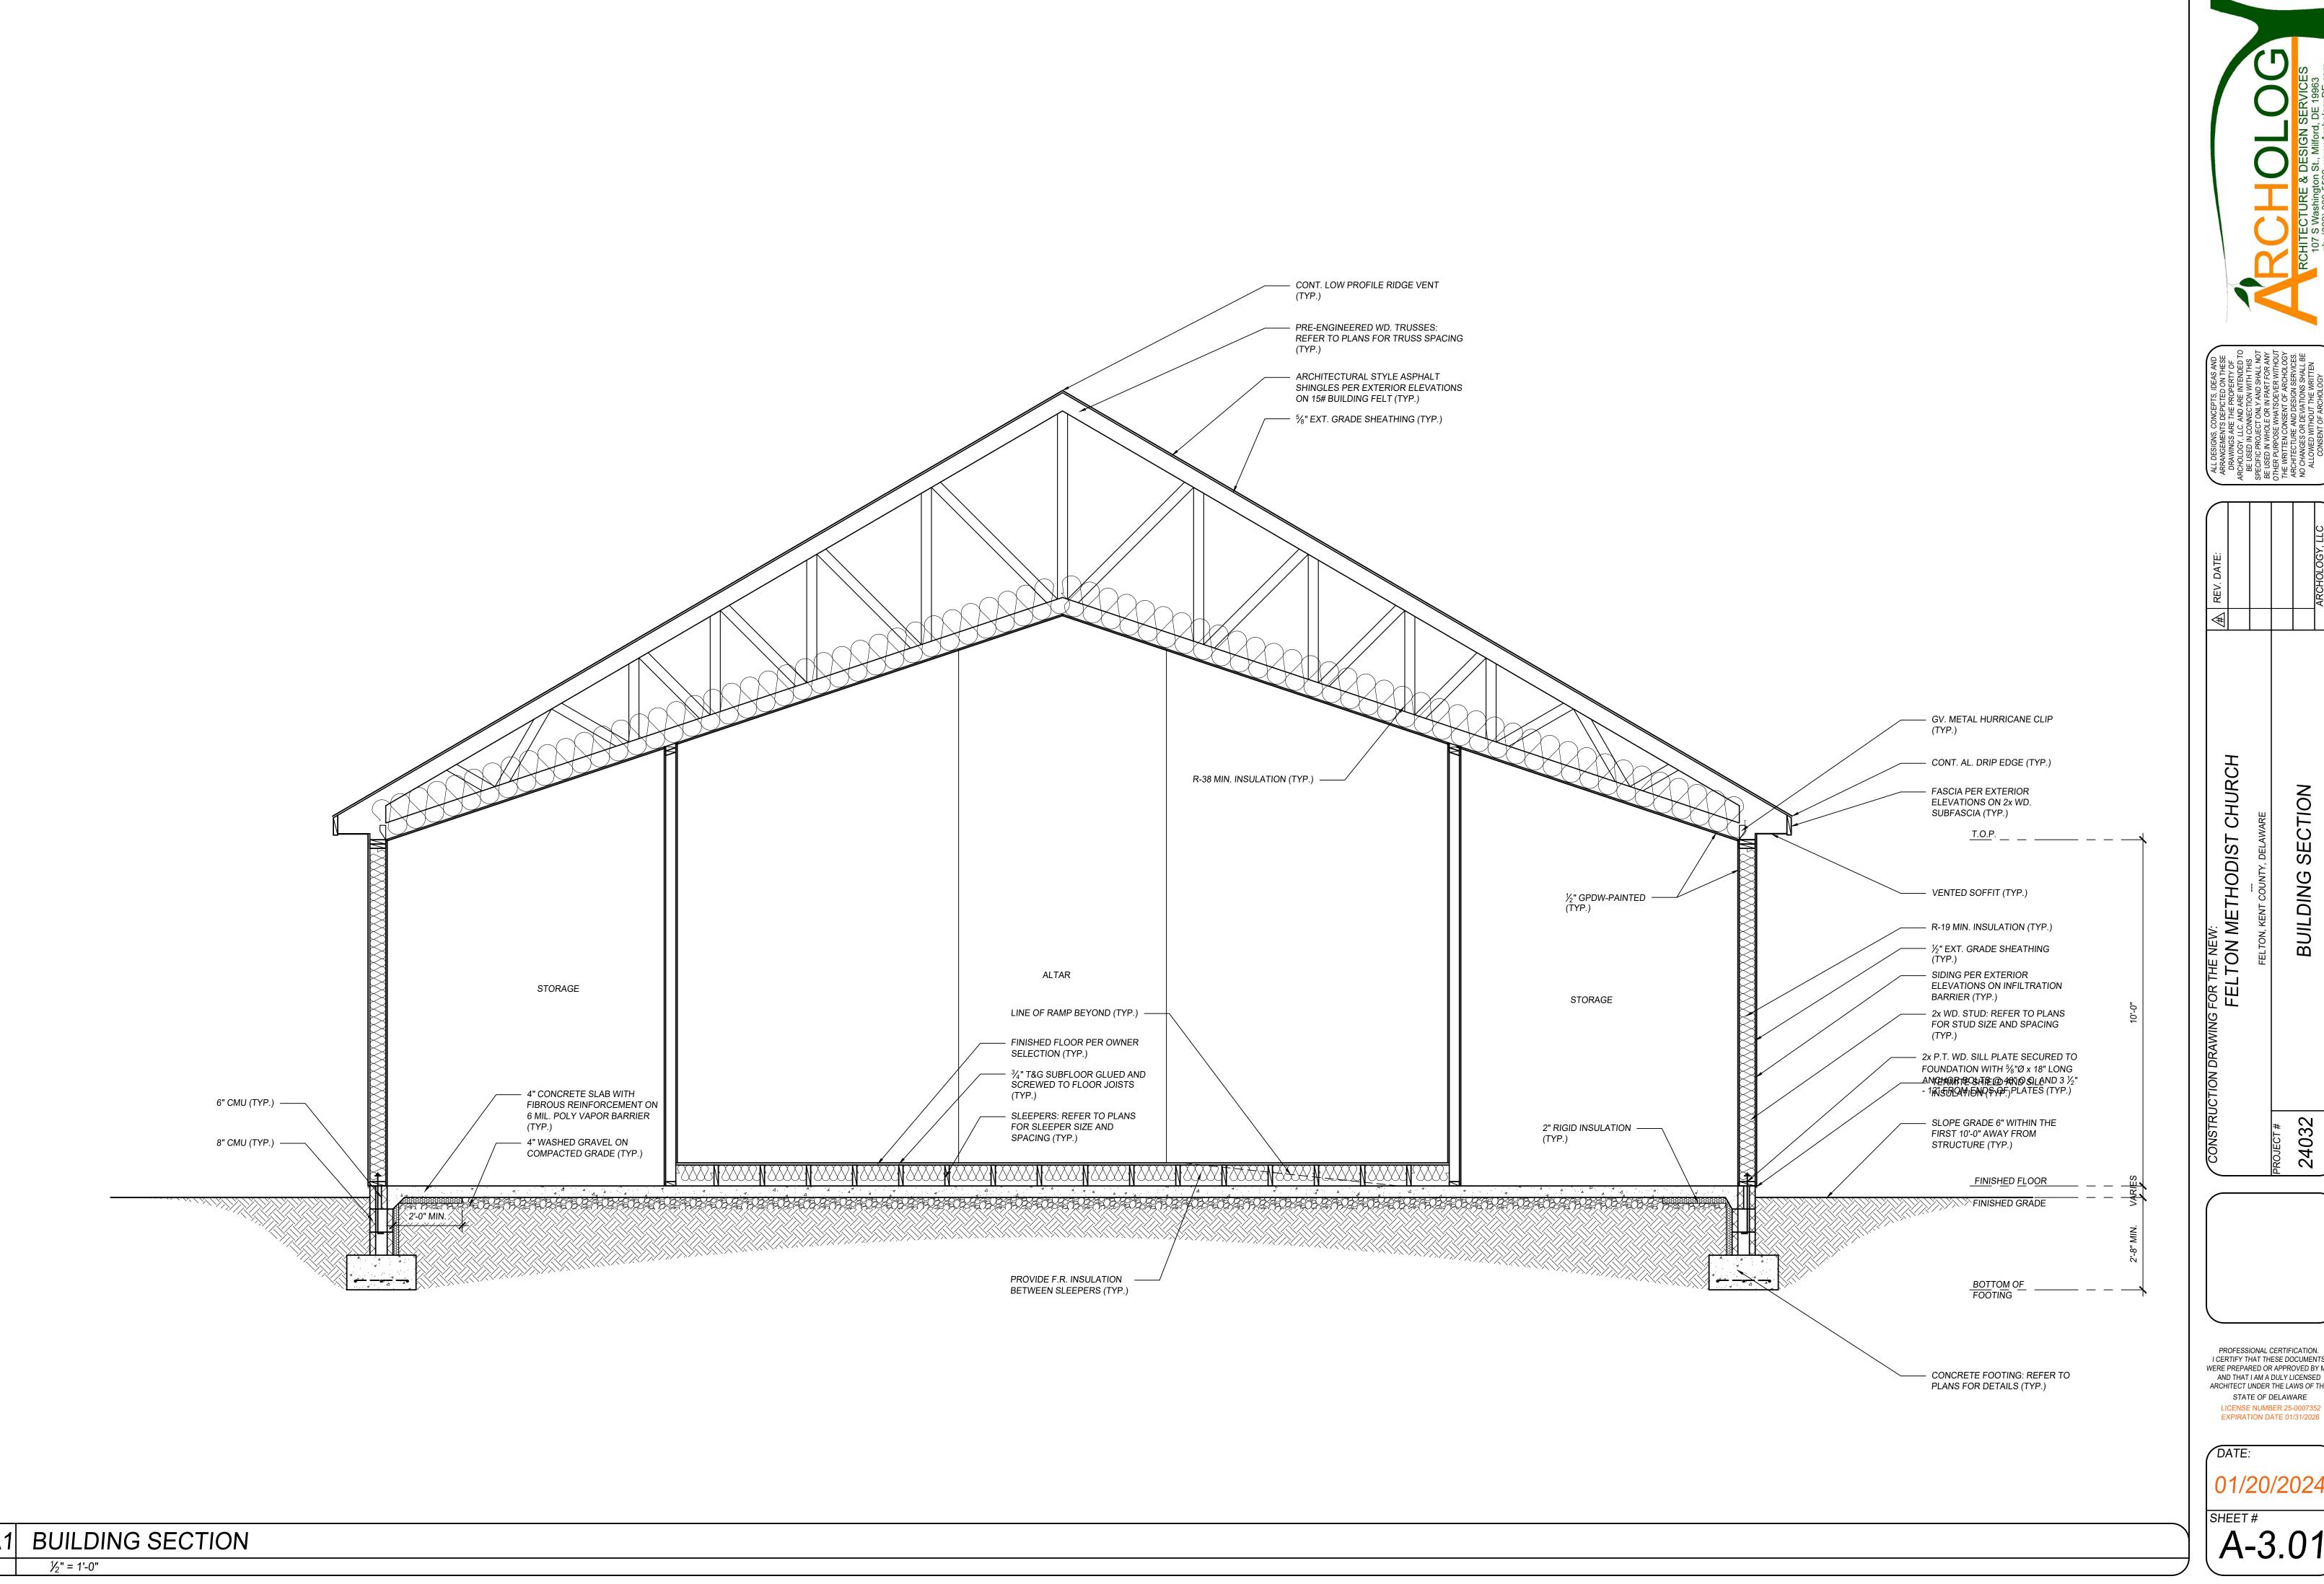

ON

FOR THE NEW: FELTON METHODIST


PROFESSIONAL CERTIFICATION.
I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED ARCHITECT UNDER THE LAWS OF THE STATE OF DELAWARE

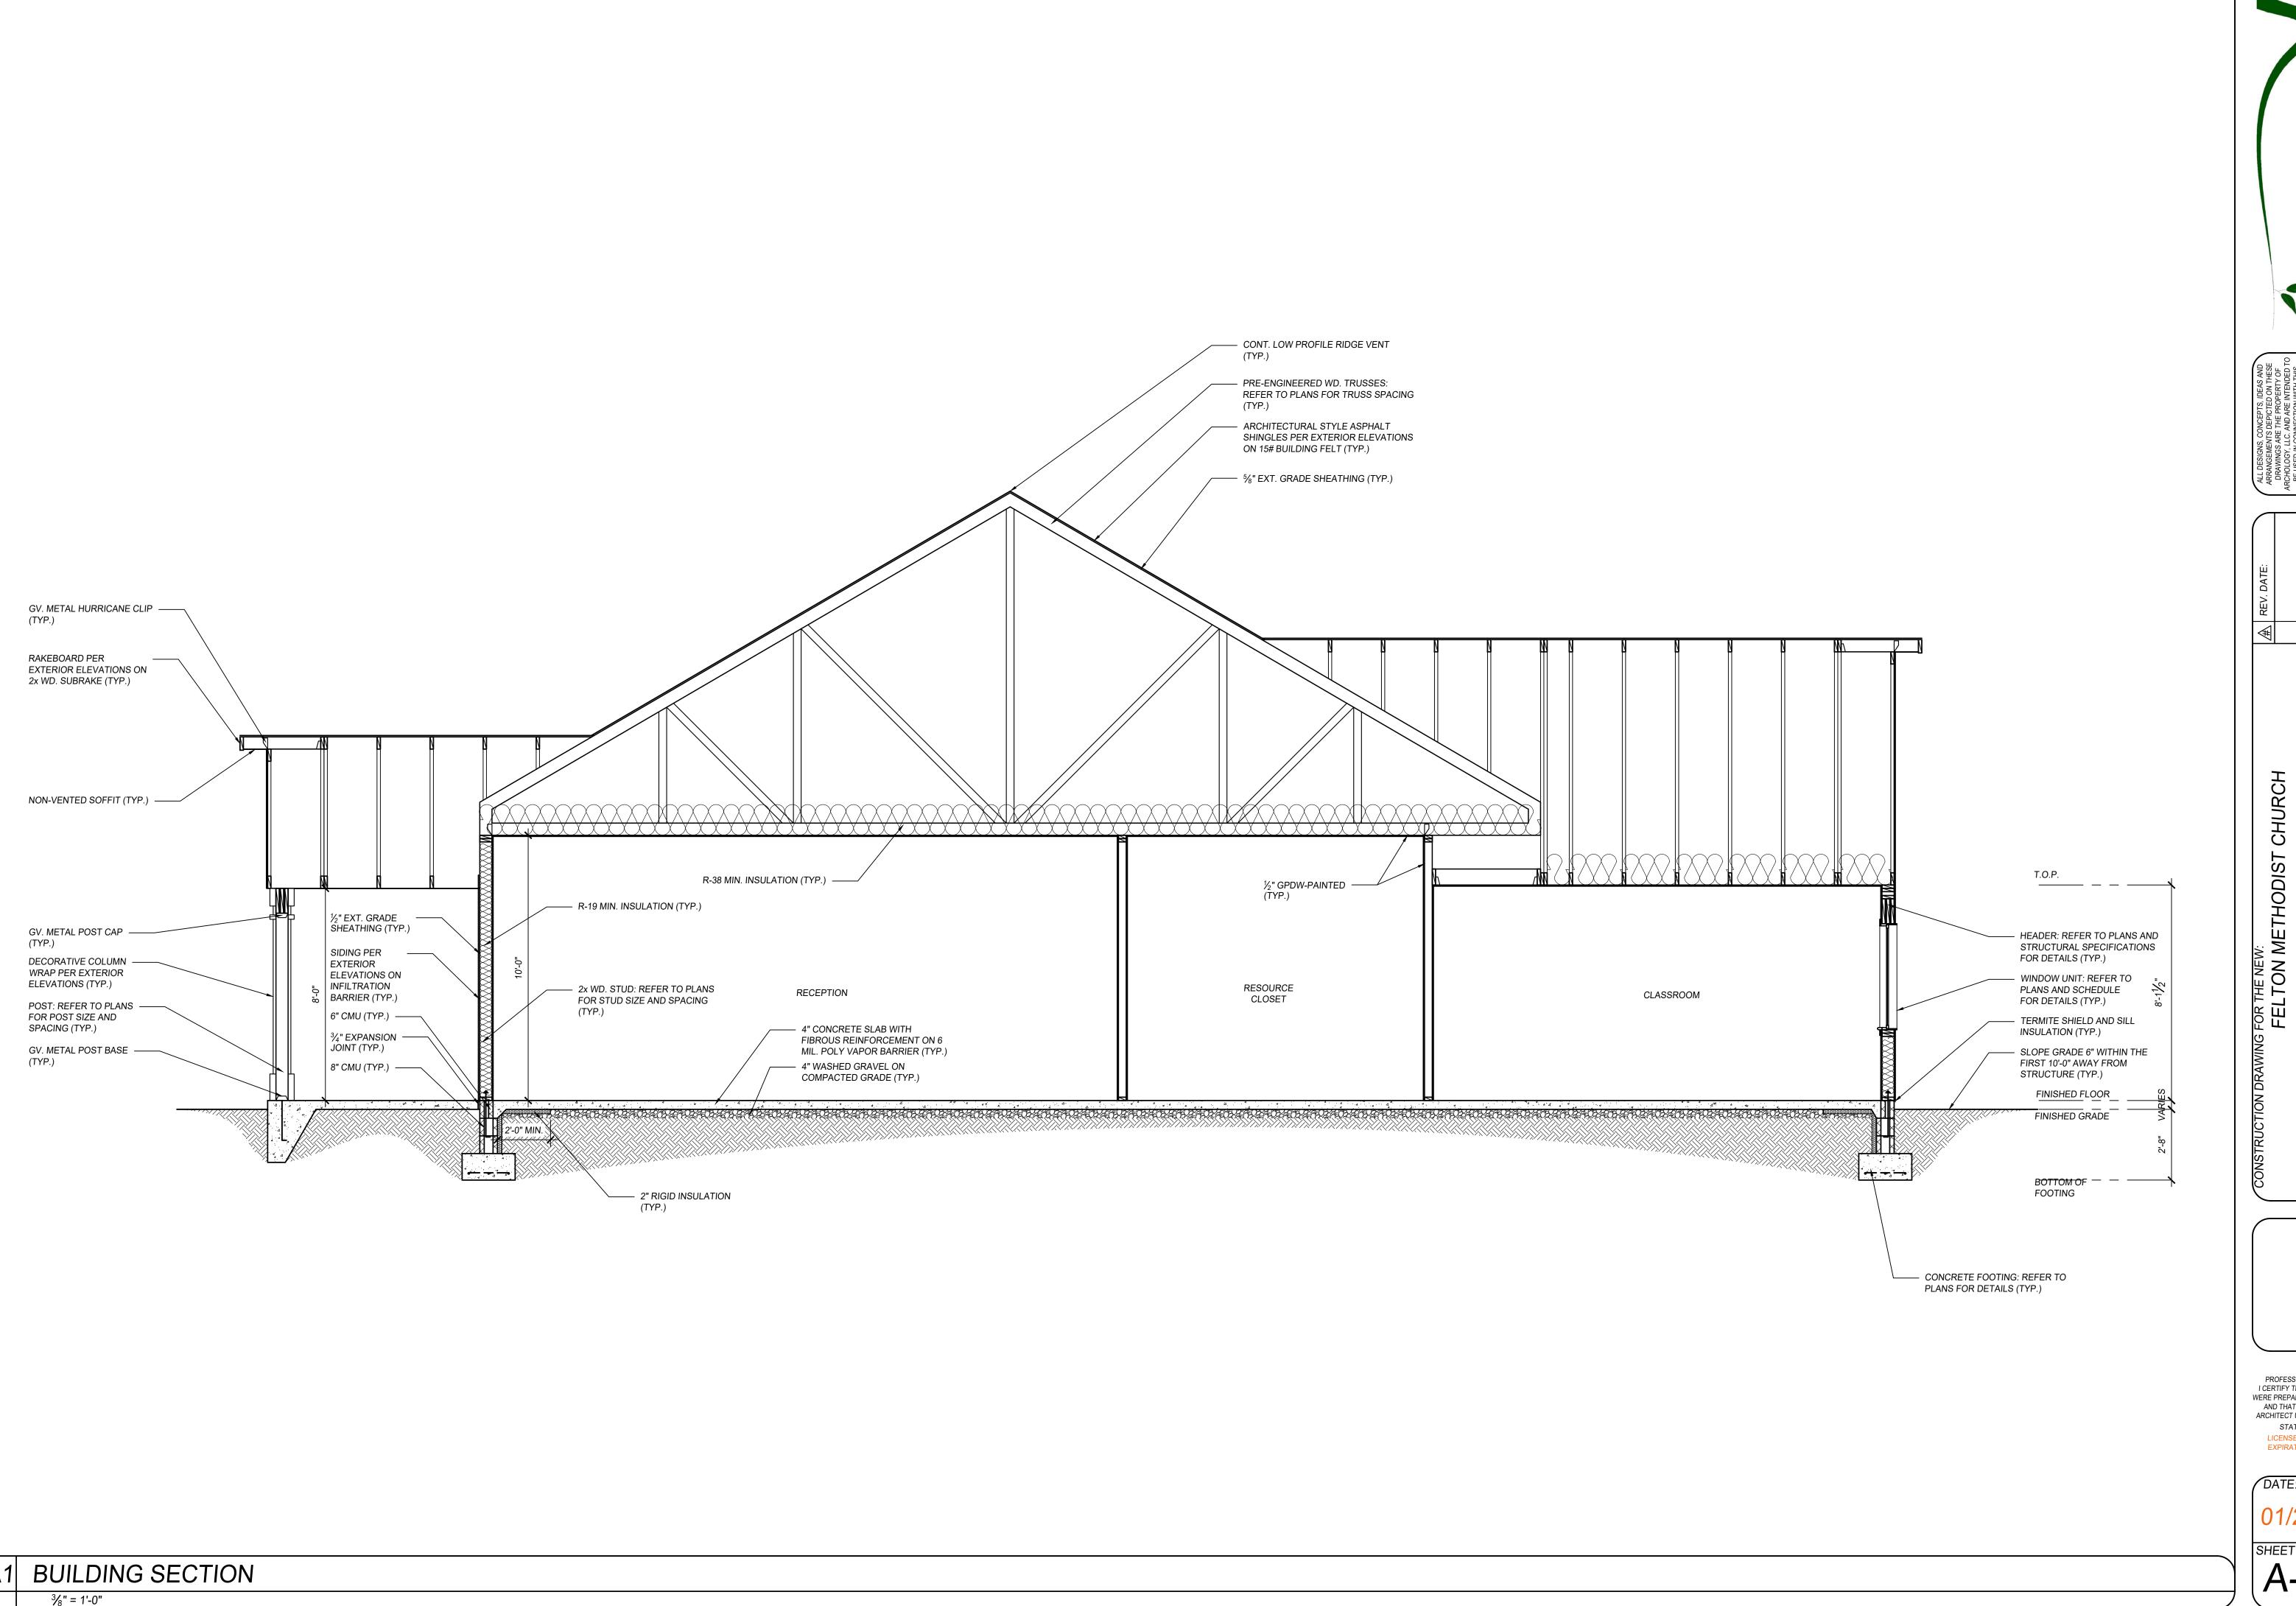

BUILDING

24032

PROFESSIONAL CERTIFICATION. I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED ARCHITECT UNDER THE LAWS OF THE STATE OF DELAWARE LICENSE NUMBER 25-0007352 EXPIRATION DATE 01/31/2026

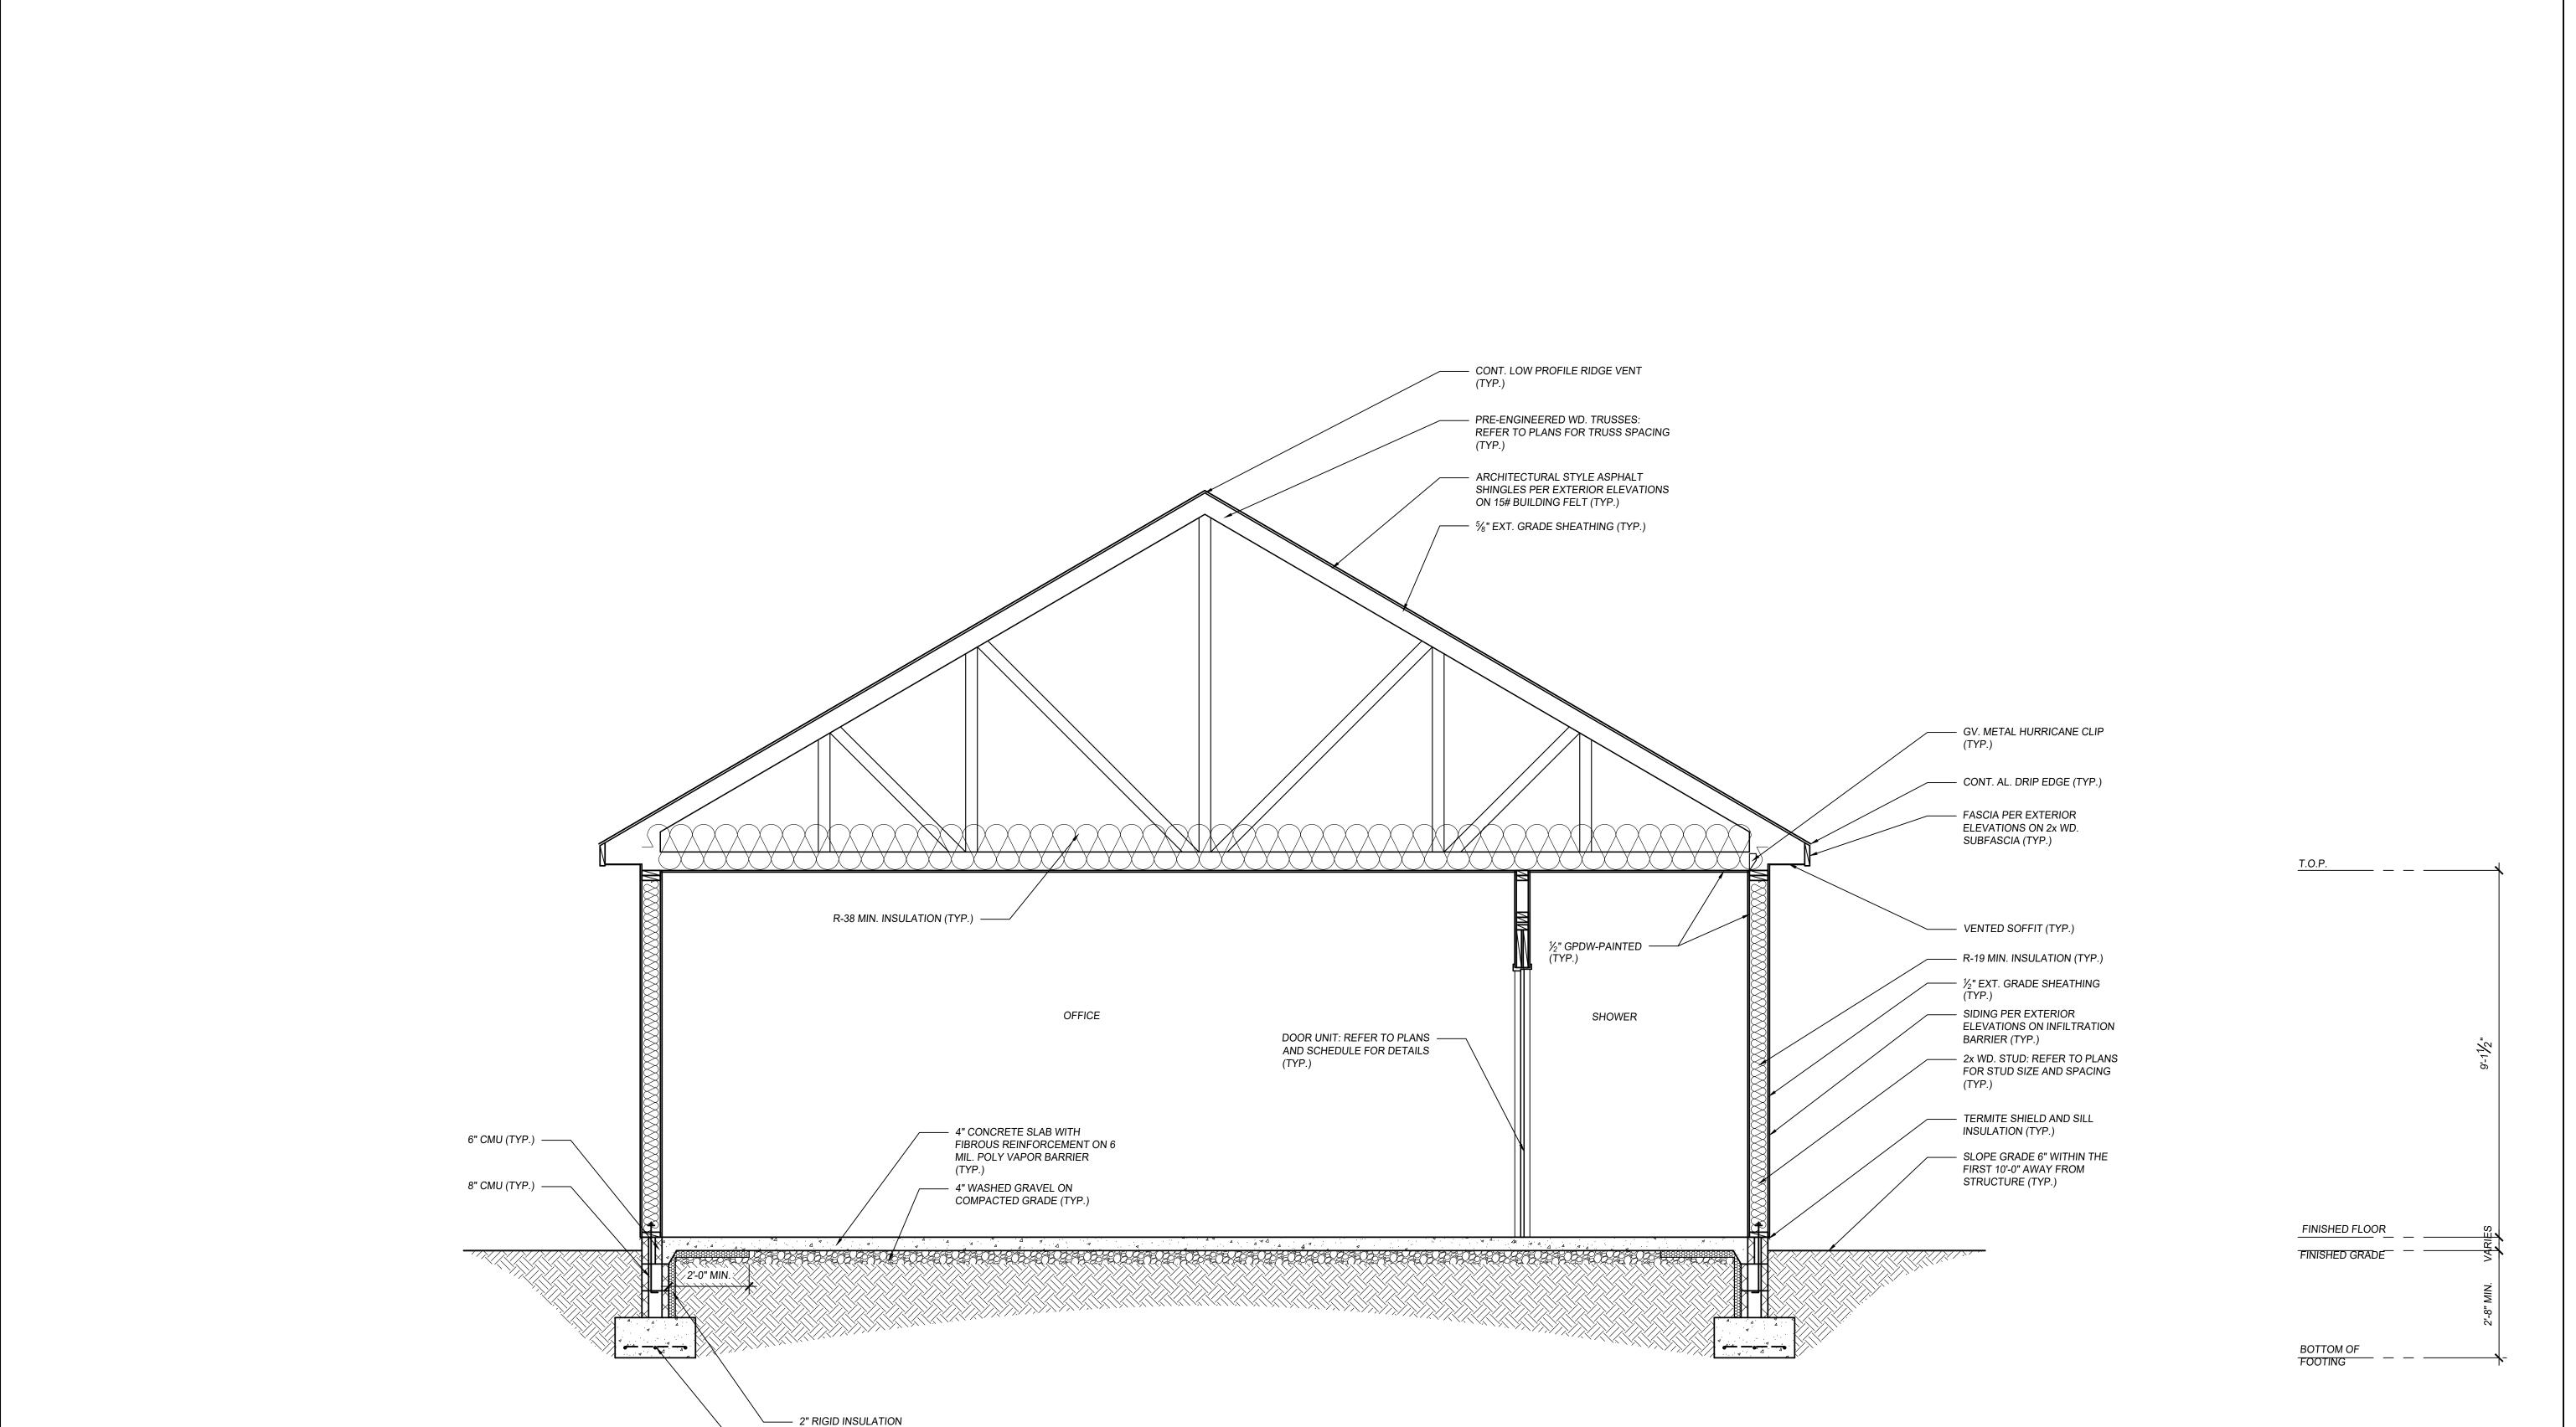

(TYP.)

- CONCRETE FOOTING:

REFER TO PLANS FOR DETAILS (TYP.)



ALL DESIGNS, CONCEPTS, IDEAS AND ARRANGEMENTS DEPICTED ON THESE DRAWINGS ARE THE PROPERTY OF ARCHOLOGY, LLC. AND ARE INTENDED TO BE USED IN CONNECTION WITH THIS SPECIFIC PROJECT ONLY AND SHALL NOT BE USED IN WHOLE OR IN PART FOR ANY OTHER PURPOSE WHATSOEVER WITHOUT THE WRITTEN CONSENT OF ARCHOLOGY ARCHITECTURE AND DESIGN SERVICES. NO CHANGES OR DEVIATIONS SHALL BE ALLOWED WITHOUT THE WRITTEN CONSENT OF ARCHOLOGY ARCHITECTURE AND DESIGN SERVICES.

REV. DATE:

ON METHODIST CHURCH
FELTON, KENT COUNTY, DELAWARE

DRAWING FOR THE NEW:
FELTON METHODIST CHU

FELTON FE

PROFESSIONAL CERTIFICATION.
I CERTIFY THAT THESE DOCUMENTS
WERE PREPARED OR APPROVED BY ME,
AND THAT I AM A DULY LICENSED
ARCHITECT UNDER THE LAWS OF THE
STATE OF DELAWARE
LICENSE NUMBER 25-0007352
EXPIRATION DATE 01/31/2026

DATE:

01/20/202

SHEET#